



CITY OF HOUSTON INVITATION TO BID

REVISED 10/27/2011

Issued: July 1, 2011

Bid Opening:

Sealed bids, in duplicate, will be received by the City Secretary of the City of Houston, in the City Hall Annex, Public Level, 900 Bagby, Houston, Texas 77002, until 10:30 a.m. Thursday, **December 1, 2011** and all bids will be opened and publicly read in the City Council Chamber, City Hall Annex, Public Level, 900 Bagby at 11:00 a.m. on that date for the purchase of:

**SUBMERSIBLE PUMP REPAIR SERVICES
FOR PUBLIC WORKS AND ENGINEERING DEPARTMENT
BID # S50-L23863
NIGP Code 720-64**

Buyer:

Questions regarding this solicitation document should be addressed to **Art Lopez, Buyer of Record at (832) 393-8731**, or e-mail to **"arturo.lopez@houstontx.gov"**

Electronic Bidding

In order to submit a bid for the items associated with this procurement, you must fill in the pricing information on the "PLACE BID" page.

Pre-Bid Conference:

A **second** Pre-Bid Conference will be held for all Prospective Bidders in the Strategic Purchasing Division, Concourse Level (Basement), Conference Room #1, City Hall, 901 Bagby, at 10:00 AM, on **Thursday, November 10, 2011**.

All Prospective Bidders are urged to be present. It is the bidder's responsibility to ensure that they have secured and thoroughly reviewed the solicitation documents prior to the Pre-Bid Conference. Any revisions to be incorporated into this solicitation document arising from discussions before, during and subsequent to the Pre-Bid Conference will be confirmed in writing by Letter(s) of Clarification prior to the bid due date. Verbal responses will not otherwise alter the specifications, terms and conditions as stated herein.

Bidding forms, specifications, and all necessary information should be downloaded from the Internet at **<http://purchasing.houstontx.gov/>**. By registering and downloading this solicitation document, all updates to this solicitation document will be automatically forwarded via e-mail to all registered bidders. This information may also be obtained from the Supplier Assistance Desk, Strategic Purchasing Division, 901 Bagby, Concourse Level, and Houston, Texas 77002. The place of the bid opening may be transferred in accordance with Paragraph (b), (5) of Section 15-3 of The Code of Ordinances, Houston, Texas. The bid opening meeting may be rescheduled in accordance with Paragraph (b), (6) of said Section 15-3.

The City reserves the right to reject any or all bids or to accept any bid or combination of bids deemed advantageous to it.

City Employees are prohibited from bidding on this solicitation in accordance with the Code of Ordinances, Section 15 - 1.

***CONTENTS:**

- SECTION A: OFFER
- SECTION B: SCOPE OF WORK/SPECIFICATIONS
- SECTION C: GENERAL TERMS & CONDITIONS

***NOTE 1: Actual page numbers for each Section may change when the solicitation document is downloaded from the Internet or because of Letters of Clarification. Therefore, Bidders must read the bid document in its entirety and comply with all the requirements set forth therein.**

***NOTE 2: To be considered for award, please submit the electronic bid form and the forms listed in Section A, including the Official Signature Page, which must be signed by a company official authorized to bind the company.**

SECTION A



SUBMERSIBLE PUMP REPAIR SERVICES FOR PUBLIC WORKS & ENGINEERING DEPARTMENT BID #S50-L23863 NIGP Code: 720-64

To The Honorable Mayor
and Members of the City Council
of the City of Houston, Texas (the "City"):

The undersigned Bidder hereby offers to contract with the City upon the terms and conditions stated in that certain **"Contract for Submersible Pump Repair Services for a three (3) year term with up to two (2) one-year option periods for Public Works & Engineering Department"** which was distributed by the City together with the "Notice to Bidders" and is hereby incorporated herein by this reference (the "Contract"). This offer is made at the prices stated on the electronic Bid Form. When issued by the City of Houston, Letters of Clarification shall automatically become part of this bid document and shall supersede any previous specifications or provisions in conflict with the Letters of Clarification. It is the responsibility of the bidder to ensure that it has obtained all such letters. By submitting a bid on this project, bidder shall be deemed to have received all Letters of Clarification and to have incorporated them into its bid.

The City may accept this bid offer by issuance of a Contract covering award of said bid to this Bidder at any time on or before the 180th day following the day this Official Bid Form is opened by the City. This offer shall be irrevocable for 180 days, but shall expire on the 181st day unless the parties mutually agree to an extension of time in writing.

The City of Houston reserves the option, after bids are opened, to increase or decrease the quantities listed, subject to the availability of funds, and/or make award by line item.

If the City accepts the foregoing offer, this Bidder promises to deliver to the City Purchasing Agent of the City, three (3) original counterparts of said Contract duly executed by this Bidder (as "Contractor") in accordance with this paragraph, proof of insurance as outlined in Article VI of the Contract, all on or before the tenth (10th) day following the day this Bidder receives from the City the unsigned counterparts shall be executed so as to make it binding upon the Bidder, and all of the applicable requirements stated in the document entitled "Instructions for Execution of Contract Documents," (which was distributed by the City) shall be complied with.

The City reserves the right to accept or reject, in whole or in part, any or all bids received and to make award on the basis of individual items or combination of items, as it is deemed in the best interest of the City.

If the City accepts the foregoing offer, this bidder shall furnish all labor, supervision, materials, supplies, equipment and tools necessary to provide submersible pump repair services for the City in accordance with attached Specifications.

ESTIMATED QUANTITIES NOT GUARANTEED

The estimated quantities specified herein are not a guarantee of actual quantities, as the City does not guarantee any particular quantity of submersible pump repair services during the term of this contract. The quantities may vary depending upon the actual needs of the user department. The quantities specified herein are good faith estimates of usage during the term of this contract. Therefore, the City shall not be liable for any contractual agreements/obligations the Contractor enters into with third parties based on the City purchasing/requiring all the quantities specified herein.

Documents/forms must be downloaded from the City's Website <http://houstontx.gov/purchasing/index.html>.

Additional Required Forms to be Included with this Bid:

In addition to the electronic Bid Form and the Official Signature Page, the Forms listed in **Table 1 must be completed and submitted to the Office of the City Secretary on or before the date and time the bid is due:**

Table 1 – Required Forms
Affidavit of Ownership.doc
Fair Campaign Ordinance.doc
<i>Hire Houston First Application and Affidavit</i>
Statement of Residency.doc
Conflict of Interest Questionnaire.doc
Pay or Play Form 1a / Acknowledgement
Contractor's Questionnaire

Table 2 lists other documents and forms that should be viewed or downloaded from the City's website, but are not required to be submitted with the bid. The City will request these forms, as applicable, to be completed and submitted to the City by the recommended/successful bidder:

Table 2 – Documents & Forms
Drug Forms.doc
M/WBE.doc
Sample Insurance Over \$50,000.pdf
Formal Instructions for Bid Terms.doc
EEOC.doc
Pay or Play Form 2 / Certification
Pay or Play Form 3 / List of Subcontractors

Notes:

1. Questions concerning the Bid should be submitted in writing to: City of Houston, Strategic Purchasing Division, 901 Bagby, Room B405, Houston, TX 77002, Attn: Art Lopez or via fax: 832-393-8759 or via email (preferred method) to arturo.lopez@houstontx.gov no later than 4:00 PM, **Monday, July 18, 2011**.
2. Although it is the intent of the City to award one contract as results of this invitation to bid, the City reserves the right to award by line item/group. The Contractor shall provide bids for all line items in all groups. An incomplete bid or partial bid response shall disqualify the Contractor's bid from further consideration.
3. The Bid Base Cost for RECONDITION-REPAIR shall include all cost of supervision, labor, tools, equipment, and supplies to complete the work as specified herein for RECONDITION-REPAIR. This Base Cost does not include the cost of bearings, seals, impellers, wear-rings, heaters, broken and damaged parts. The cost of bearings, seals, impellers, wear-rings, heaters, broken and damaged parts are reimbursable, if authorized by the user department representative (UDR).
4. The Bid Base Cost for REWIND-REPAIR shall include all cost of supervision, labor, tools, equipment,

supplies, and parts to complete the work as specified herein for REWIND-REPAIR. This Base Cost does not include the cost of bearings, seals, impellers, wear-rings, heaters, broken and damaged parts. The cost of bearings, seals, impellers, wear-rings, heaters, broken and damaged parts are reimbursable, if authorized by the UDR.

5. **DELETED:**

6. **WARRANTY:** **REVISED 10/27/2011**

The Contractor must provide written documentation within ten (10) calendar days after bid opening detailing under what circumstance a Warranty claim would be denied. Failure to provide this documentation within 10 calendar days after bid opening may be cause for rejection of the bidders bid.

SITE INSPECTION:

"The City of Houston reserves the right to inspect the bidder's current place of business to evaluate a) equipment condition and capabilities, b) staff experience, training and capabilities, and c) storage capabilities as they relate to the performance of this contract."

HIRE HOUSTON FIRST

Designation as a City Business or Local Business

To be designated as a City or Local Business for the purposes of the Hire Houston First Program, as set out in Article XI of Chapter 15 of the Houston City Code, a bidder or proposer must submit the Hire Houston First Application and Affidavit ("HHF Affidavit") to the Director of the Mayor's Office of Business Opportunities and receive notice that the submission has been approved prior to award of a contract. Bidders are encouraged to secure a designation prior to submission of a bid or proposal if at all possible.

Download the HHF Affidavit from the Office of Business Opportunities Webpage at the City of Houston e-Government Website at the following location:

www.houstontx.gov/obo/moreforms/hirehoustonfirstaffidavit.pdf

Submit the completed application as directed on the form, or submit a signed original affidavit with your bid.

Award of Procurement of \$100,000 or More for Purchase of Non-Professional Services , Including Construction Services:

THE CITY WILL AWARD THIS PROCUREMENT TO A " CITY BUSINESS," AS THAT TERM IS DEFINED IN SECTION 15-176 OF THE CITY OF HOUSTON CODE OF ORDINANCES ("THE CODE"):

- **IF THE BID OF THE LOCAL BUSINESS IS THE LOWEST RESPONSIBLE BID OR IS WITHIN 3% OF THE LOWEST BID RECEIVED, AND**
- **UNLESS THE USER DEPARTMENT DETERMINES THAT SUCH AN AWARD WOULD UNDULY INTERFERE WITH CONTRACT NEEDS, AS PROVIDED IN SECTION 15-181 OF THE CODE.**

IF THERE IS NO BID OF A LOCAL BUSINESS THAT MEETS THESE CRITERIA, THE CITY WILL AWARD THE PROCUREMENT TO THE LOWEST RESPONSIBLE BIDDER.

Award of Procurement under \$100,000 Purchase of Non-Professional Services Including Construction Services:

THE CITY WILL AWARD THIS PROCUREMENT TO A "LOCAL BUSINESS," AS THAT TERM IS DEFINED IN SECTION 15-176 OF THE CITY OF HOUSTON CODE OF ORDINANCES ("THE CODE"):

- **IF THE BID OF THE CITY BUSINESS IS THE LOWEST RESPONSIBLE BID OR IS WITHIN 5% OF THE LOWEST BID RECEIVED, AND**
- **UNLESS THE USER DEPARTMENT DETERMINES THAT SUCH AN AWARD WOULD UNDULY INTERFERE WITH CONTRACT NEEDS, AS PROVIDED IN SECTION 15-181 OF THE CODE.**

IF THERE IS NO BID OF A LOCAL BUSINESS THAT MEETS THESE CRITERIA, THE CITY WILL AWARD THE PROCUREMENT TO THE LOWEST RESPONSIBLE BIDDER.

Award of Procurement that may be More or Less than \$100,000 for Purchase of Non-Professional Services, Including Construction Services:

THE CITY WILL AWARD THIS PROCUREMENT TO A "LOCAL BUSINESS," AS THAT TERM IS DEFINED IN SECTION 15-176 OF THE CITY OF HOUSTON CODE OF ORDINANCES ("THE CODE"):

- **IF THE BID OF THE LOCAL BUSINESS IS LESS THAN \$100,000 AND IS THE LOWEST RESPONSIBLE BID OR IS WITHIN 5% OF THE LOWEST BID RECEIVED, OR**
- **IF THE BID OF THE LOCAL BUSINESS IS MORE THAN \$100,000 AND IS THE LOWEST RESPONSIBLE BID OR IS WITHIN 3% OF THE LOWEST BID RECEIVED, AND**
- **UNLESS THE USER DEPARTMENT DETERMINES THAT SUCH AN AWARD WOULD UNDULY INTERFERE WITH CONTRACT NEEDS, AS PROVIDED IN SECTION 15-181 OF THE CODE.**

IF THERE IS NO BID OF A LOCAL BUSINESS THAT MEETS THESE CRITERIA, THE CITY WILL AWARD THE PROCUREMENT TO THE LOWEST RESPONSIBLE BIDDER.

CONTRACTOR'S QUESTIONNAIRE

In order to receive bid award consideration, the bidder must be able to demonstrate that they are currently providing or have had at least one contract, as a prime contractor, for submersible pump repair services that is similar in size and scope to this contract. **Bidder must have references documenting that it has performed submersible pump repair services on Flygt Submersible Pumps and/or Myers, KSB and Miscellaneous Small Submersible Pumps with fractional horsepower from 2 horsepower to 125 horsepower.** The reference(s) should be included in the space provided below. Please attach another piece of paper if necessary. If references are not included with the bid, the bidder shall be required to provide such references to the City of Houston within five working days from receipt of a written request from the City of Houston to do so. **Bidder's capability and experience shall be a factor in determining the contract award.**

- 1. Name: _____
Address: _____
City & State: _____
Name & Phone Number of Contact: _____ Years Services: _____
- 2. Name: _____
Address: _____
City & State: _____
Name & Phone Number of Contact: _____ Years Services: _____
- 3. Name: _____
Address: _____
City & State: _____
Name & Phone Number of Contact: _____ Years Services: _____
- 4. Name: _____
Address: _____
City & State: _____
Name & Phone Number of Contact: _____ Years Services: _____
- 5. Name: _____
Address: _____
City & State: _____
Name & Phone Number of Contact: _____ Years Services: _____

CONTRACTOR'S FACILITY AND INSPECTION

The City of Houston will deliver to and pickup from the Contractor's shop the submersible pumps. The City will monitor the repair of its submersible pumps on a daily basis. The successful bidder shall maintain a repair facility within 50 miles from City Hall located at 901 Bagby, to allow for delivery, pickup, monitoring and inspection of submersible pumps at Contractor's location (workplace) by City of Houston Personnel.

The facility shall meet all Federal, State, Building Codes, regulations of Fire Department, City of Houston and/or local regulations, ordinances, codes and standards which ***govern such facilities and the equipment therein.***

The Contractor shall furnish the City Inspection Team valid documents indicating the facility meets the current OSHA, Safety requirements, current EPA, and TCEQ requirements for air and water pollution as related to the equipment at the facility.

The facility shall have an area designated as ***storage area*** for safe storage of the submersible pumps under repair, submersible pump components, and the repaired submersible pumps awaiting shipment. This area shall be covered, weather protected and isolated from teardown, sandblasting, steam cleaning and similar sources of contaminants that could damage the components or the submersible pumps. The parts and submersible pumps shall be kept off the ground. The storage area shall be at Contractor's shop.

The facility shall have an area designated as ***teardown area***. The teardown area shall be covered, weather protected and isolated from storage and assembly areas. The teardown area shall be at Contractor's shop.

The facility shall have an area designated as ***assembly area***. The assembly area shall be covered, weather protected and isolated from teardown, sandblasting and similar contaminants that could damage components or the submersible pumps. The assembly area shall be at Contractor's shop.

The facility shall have all the necessary ***overhead cranes and/or jib cranes*** to handle the submersible pumps equipped with lifting eyes, or similar factory lifting points throughout the repair process. This applies to both Contractor's shop and the approved subcontractors.

The facility shall have a ***paint booth***, which meets all applicable Federal, State, and local regulations, ordinances, codes and standards. The paint booth may be at Contractor's shop or at approved subcontractor's shop.

The facility shall have a ***pressure washer and steam-cleaning machine***, which meets all applicable Federal, State, and local regulations, ordinances, codes and standards. The machine shall provide water at 200 degrees Fahrenheit and at 30-pounds per square inch. The pressure washer and steam machine may be at Contractor's shop or at subcontractor's shop.

The facility shall have a ***burnout oven***, which meets all applicable Federal, State, and local regulations, ordinances, codes and standards. The furnace temperature shall be automatically controlled and have a chart recorder and the controller shall have the tag of the latest calibration. The controller shall indicate and control the furnace temperature by furnace air temperature. The burnout oven may be at Contractor's shop or at approved subcontractor's shop.

The facility shall have a ***baking oven***, which meets all applicable Federal, State, and local regulations, ordinances, codes and standards. The furnace temperature shall be automatically controlled and the controller shall have the tag of the latest calibration. The controller shall indicate and control the furnace temperature by furnace air temperature. The baking oven may be at Contractor's shop or at approved subcontractor's shop.

The facility shall have a ***varnish dip-tank***, which meets all applicable Federal, State, and local regulations, ordinances, codes and standards. The dip-tank shall be at Contractor's shop or at approved subcontractor's shop.

The facility shall have, or shall have access to, a **Vacuum Pressure Impregnation (VPI) system**, which meets all applicable Federal, State, and local regulations, ordinances, codes and standards. The VPI system may be at Contractor's shop or at approved subcontractor's shop.

The facility shall have **precision V-Blocks** to check the largest size (125 HP) rotor assembly for roundness and run out. The checking shall be performed using dial indicators. The V-Blocks shall be at Contractor's shop.

The facility shall have **balancing machine(s)** to perform balancing of the largest size (125 HP) rotor assembly. The machine shall have a printout of the values of "before" and "after" balancing. The balancing machine may be at Contractor's shop or at approved subcontractor's place.

The facility shall have adequate access for City of Houston delivery vehicles to enter, load/unload, and exit safely without exposing the operator of the vehicle to danger such as backing in traffic lanes, crossing medians. This applies to both Contractor and approved subcontractors shops.

The facility shall have the **testing equipment** and the set-up to safely conduct all recommended final tests including a NO LOAD test run and the vibration test of the repaired submersible pump at the highest rated voltage and the rated frequency of the submersible pump. The testing equipment shall be at Contractor's shop or at approved subcontractor's shop.

The facility shall have the **testing equipment** and the set-up to safely do all recommended tests before and after recondition-repair and rewind-repair of the submersible pumps. The check and test equipment shall include (but not limited to) meggers, loop or core loss tester, high-potential DC tester, surge-comparison tester, growler, infrared thermography camera and submersible pump test panel to test the largest submersible pump in this contract. The testing equipment may be at Contractor's shop or at approved subcontractor's place.

Each instrument and testing equipment shall bear record of **recent calibration**. Refer to Item B.00.07 of this specification for specific requirements.

The facility shall have a **coil-manufacturing machine** equipped with turn counter. The coils shall be wound with minimum crossovers and have uniform cross-section coils. The coil-manufacturing machine may be at Contractor's shop or at approved subcontractor's shop.

The facility shall have a **coil-winding room**, isolated from teardown, sandblasting, painting, and similar contaminated areas that could possibly shorten the life expectancy of a winding. The coil-winding room may be at Contractor's shop or at approved subcontractor's place.

The Contractor shall provide a smoke-free environment for the City Inspector to check the job progress and observe the test run. This applies to both Contractor's shop and approved subcontractor's shop.

ALL TOOLS, ALL EQUIPMENT, AND THE QUALIFIED STAFF (RESUMES TO BE PROVIDED BY CONTRACTOR INCLUDED) REQUIRED TO DO THE WORK SPECIFIED BY THIS CONTRACT SHALL BE IN PLACE AND FULLY OPERATIONAL AND MEETING THESE SPECIFICATIONS DURING A "SHOP INSPECTION" OF THE BIDDER'S REPAIR FACILITY AND ITS SUB-CONTRACTORS.

THE BIDDER AND ITS SUB-CONTRACTORS SHALL BE READY FOR THE CITY "INSPECTION TEAM" WITHIN 72 HOURS OF A VERBAL OR WRITTEN NOTIFICATION FROM THE CITY PURCHASING AGENT OR DESIGNEE. THERE SHALL BE ONLY ONE "SHOP INSPECTION."

FAILURE OF THE BIDDER TO SATISFY THE REQUIREMENTS SET-FORTH ABOVE SHALL DISQUALIFY THE BIDDER FROM FURTHER CONSIDERATION.

QUALITY AND WORKMANSHIP:

The bidder must be able to demonstrate upon request that it has satisfactorily performed services similar to the services specified herein. The bidder will provide records of warranty and repair services upon request by the City. The City of Houston shall be the sole judge as to whether the services performed are similar to the scope of services contained herein and whether the bidder is capable of performing such services.

SECTION B
SCOPE OF WORK/SPECIFICATIONS

REVISED 7/22/2011

SMALL SUBMERSIBLE PUMP REPAIR SERVICES

WASTEWATER AND DRINKING WATER OPERATIONS

B.00 GENERAL REQUIREMENTS AND SCOPE OF SERVICES:

- B.00.01 The Contractor shall furnish all supervision, labor, parts, tools, materials, equipment, supplies, and facilities necessary to provide precise repair services for small submersible pumps from various facilities of City of Houston. The City will monitor the repair of its submersible pumps on a daily basis.
- B.00.02 The meaning of some specific terms as used in this contract is given in Exhibit A, Definitions.
- B.00.03 The Small Submersible Pumps covered by this contract are grouped to indicate the manufacturer, size, and type of the units. See Exhibit A, Definitions, for the list.
- B.00.04 This contract covers the general requirements for the reconditioning, rewinding, repairing, replacing and testing of the small submersible pumps located at City of Houston facilities. This includes, but is not limited to, motor stator coils, motor stator iron, motor rotor, pump casing, pump impeller, pump volute, wear rings, bearings, seals, and electrical/mechanical work. This specification defines minimum acceptable requirements for the repair of the units and documentation of those repairs as specified in Item B.12 herein entitled Invoices and Exhibit B.
- B.00.05 Unless otherwise specified, fabrications, processes, parameters, and test methods for the motors of the submersible pumps shall conform to the latest revision of the following **ELECTRICAL APPARATUS SERVICE ASSOCIATION (EASA)** documents and ASTM guide:
- EASA AR100-2010 - **RECOMMENDED PRACTICE FOR REPAIR OF ROTATING APPARATUS** (hereafter abbreviated as EASA AR100-2010);
 - EASA Technical Note No. 16 – **GUIDELINES FOR MAINTAINING MOTOR EFFICIENCY DURING REBUILDING**, September 1999 (hereafter abbreviated as EASA Tech Note No. 16);
 - EASA Technical Note No. 17 – **STATOR CORE TESTING**, updated March 1997 (hereafter abbreviated as EASA Tech Note No. 17); and
 - EASA Bearing Fit Tolerance Chart, updated 1997
 - ASTM E1934-99a(2005e1) – Standard Guide for Examining Electrical and Mechanical Equipment and Infrared Thermography (herein abbreviated as ASTM E 1934)
- B.00.06 ALL MOTOR repair and services shall be performed in a manner to comply with the applicable sections of standards and codes listed in B.00.05.
- B.00.07 All test equipment required for test results shall be calibrated at a minimum of once a year and adhering to standards traceable to the National Institute of Standards and Technology (NIST) or equivalent standards laboratories (see EASA AR100-21010). The Contractor shall establish, document, and maintain calibration records for testing and measuring equipment used to demonstrate conformance of product to specified requirements.
- B.00.08 The submersible pumps at City facilities are purchased and installed under City's master

Specifications (a copy of Master Specifications Section 11311, Submersible Wastewater Pumps, GHWP, dated 06/28/2005 or latest edition will be included as a part of this document) requiring compliance with the applicable sections of the following standards and codes:

- American National Standard Institute (ANSI)
- American Society for Testing and Materials (ASTM)
- Anti-Friction Bearing Manufacturing Association (AFBMA)
- Hydraulic Institute
- Institute of Electrical and Electronic Engineers (IEEE)
- National Electric Code (NEC)
- National Electrical Manufacturers Association (NEMA)
- Steel Structures Painting Council (SSPC)
- City of Houston Electrical Code

B.00.09 Wherever this document refers to the following codes and standards, the specific sections of the code/standard shall apply to the repairs being carried out by the Contractor and/or subcontractor:

- Steel Structures Painting Council (SSPC)
- Anti-Friction Bearing Manufacturing Association (AFBMA)
- American Society for Non-Destructive Testing

B.00.10 A copy of Master Specifications Section 11311, Submersible Wastewater Pumps, GHWP, dated 06/28/2005 or latest edition is attached and shall become a part of this repair and service contract.

B.00.11 The Contractor shall furnish, when requested by the **contract technical representative** (CTR), copies of current environmental permits and demonstrate compliance with current environmental regulations.

B.00.12 Subcontractors to the Contractor are subject to all standards as the Prime Contractor.

B.00.13 THE CONTRACT "FEES AND COSTS" EXHIBIT "H" SHALL BE BASED ON THE CONTRACTOR USING NEW AND ORIGINAL EQUIPMENT MANUFACTURER (OEM) PARTS OR NEW NON-OEM PARTS IN THE REPAIR OF CITY'S SUBMERSIBLE PUMPS.

B.00.14 The price of parts and material and cost of a replacement unit supplied for this contract shall be the total original invoiced cost to the contractor plus contractor's quoted percentage (%) markup or percent (%) discount for the item. The Contractor shall submit all ORIGINALS of the supporting documentations with the FINAL invoice.

B.00.15 ALL prices for parts and any markup or discount shall be based upon OEM Manufacturer's latest Price List for distributorships or cost plus (+) markup for Non-OEM parts for Non-OEM distributorships. This is applicable to the parts section of the Bid Forms and subsequently will be incorporated into Exhibit "H" entitled "Fees and Costs" of the Contract.

B.00.15.1 Vendor may be asked to provide pricing for both OEM and Non-OEM Repair parts.

B.00.16 The Contractor who is an OEM Distributor/Shop shall use the OEM's latest list price utilizing the OEM Distributor/Shop's **applied discount percentage (%) (plus) + or (minus) -** for the price of OEM parts and material and cost of a replacement unit supplied for this contract.

- B.00.17 ALL MARKUPS SHALL BE BASED ON CONTRACTOR'S ACTUAL COST OR SUB-CONTRACTOR'S ACTUAL ORIGINAL INVOICED DOCUMENTS. THE CONTRACTOR SHALL SUBMIT THESE ORIGINAL INVOICES, AS ATTACHMENTS, WITH THE FINAL INVOICE FOR PAYMENT BY THE CITY FOR THE WORK PERFORMED BY THE CONTRACTOR.
- B.00.18** At Contractor's repair facility, the Contractor shall ***disassemble and inspect*** the unit (D&I), provide recommendations and prepare a scope of work to repair and/or replace parts with *new* OEM parts **or new Non-OEM parts**. The cost of inspection, recommendations and preparation of work scope shall be a part of the base cost of any Recondition-Repair or Rewind-Repair job per Exhibit "H", Fees and Costs.
- B.00.19** **If the Contractor plans to use any part other than an OEM part, the Contractor shall obtain written permission from the user department representative (UDR) and/or the contractor technical representative (CTR) before using parts.** The contractor shall submit specification and documentation on the proposed substitution. Substitution of parts shall be of equal or better material and craftsmanship and shall perform as well as **OEM** part.
- B.00.19.1** **All Repair or replacement parts shall equal or exceed specifications for OEM repair or replacement parts.**
- B.00.20 The City reserves the rights to pick up any and all parts that are quoted by the Contractor to be replaced. This includes (but is not limited to) seals, bearings, and other items of a submersible pump unit.
- B.00.21 A City representative will pick up all non-repairable submersible pumps and pump components from the contractor facility. Non-repairable units do not need to be reassembled.
- B.00.22 Where hourly work is performed on behalf of the City, the Contractor (and approved sub-contractor) shall fully document the start of the work, the time spent on the job, and completion of each job. The documentation shall be punch card/time-clock, shop record or any other mutually agreed method, see **Exhibit "B-10"**.
- B.00.23 The Contractor shall ensure the equipment ***inventory number*** (EI) tag remains attached to the equipment. The Contractor shall notify the UDR if the (EI) tag is damaged or missing.
- B.00.24 Wherever torque values are known, the Contractor shall use a torque wrench and adhere to the OEM torque values.
- B.00.25 When requested by the UDR, the Contractor shall furnish parts needed for maintenance activities of submersible pumps by City Personnel. The Contractor shall charge the same price and mark-up or discount for these parts as scheduled in Bid Forms and Contract Fee Exhibit "H" under "Parts and Material."
- B.00.26 Paint booth shall not be used for sandblasting.
- B.00.27 Upon receipt of the submersible pumps the Contractor shall verify and document all information about the condition of the units including nameplate data. The Contractor shall inspect the unit and document the damaged and missing parts on the teardown report.
- B.00.28 Digital photographs of each unit, as received and the damaged components will be taken and included within the teardown report.

- B.00.29 In the case of dual horsepower units, charges shall be based only on the higher horsepower rating, never on both.
- B.00.30 Any equipment in care of contractor or removed from City property shall be documented on a City Equipment Release form, see Exhibit B-6. The department requesting services shall provide the form. The user department shall adjust the form to reflect the Contract, Ordinance and Service Release Order (SRO) numbers pertaining to this Contract.
- B.00.31 The Contractor shall provide a list, to the City of the name(s) and location(s) of shop(s) that will be used for specified repair work and obtain written approval before start of the contract. After the start of the contract, any additional subcontractor must be approved prior to commencement of work. The Contractor shall submit information on the subcontractor with a brief description and explanation of the addition. This addition will not take effect until written approval from the CTR is obtained.
- B.00.32 All metal parts shall be checked for structural integrity and cracks, and shall be repaired or replaced to meet required codes as well as industry and performance standards.
- B.00.33 Terminal boxes and auxiliary equipment enclosures shall be made to meet OEM's specifications.
- B.00.34 All illegible or defective nameplates shall be replaced upon completion of repair. All original nameplate information, except where changed, shall be stamped on new nameplate. New nameplates shall be permanently attached with mechanical fasteners. The cost of a new nameplate shall be included as a part of the base cost of any recondition-repair or rewind-repair.
- B.00.35 The Contractor shall install a stainless steel identification tag stamped with the contractor's name, job number, and repair date on each submersible pump housing. The tag shall be secured with stainless drive pins. The cost of the identification tag shall be included as a part of the base cost of any recondition-repair or rewind-repair.
- B.00.36 All submersible pumps with peeling paint or rust shall be sandblasted. The cost of sandblasting shall be included as a part of the base cost of any recondition-repair or rewind-repair.
- B.00.37 Assembled submersible pump units shall be tested for vibration. The vibration level shall not exceed 0.1 inches per second unfiltered. The vibration measurements shall be recorded on the final test sheet. For single vane impeller the vibration level shall not exceed 0.2 inches per second unfiltered. All costs associated with the vibration test shall be included as a part of the base cost of any recondition-repair or rewind-repair work.
- B.00.38 The enclosed City of Houston forms in Exhibit B-1, *Teardown and Recommended Repair Report, U. L. Certification, Shop Acceptance Tests, Field Acceptance Tests, Equipment Release Authorization, Recommended Repair Estimate, Fits and Indicated Runout, Progress Status Report, Invoice Checklist Report and Timesheet Report Forms* included in this document shall be used on each recondition-repair, rewind-repair, and new submersible pump purchases.
- B.00.39 Steam clean area shall be so designed with all the run-offs captured into an approved oil/grease recovery system.
- B.00.40 Delivery tickets and packing slips will contain quantity, part number, description of commodity delivered, name of department or section, facility name to which the

merchandise originated from, the City of Houston Ordinance, Contract and SRO numbers, signature of UDR, signature of receiving employee, printed names, employee number, date received and the authorization release number.

B.00.41 The repair shop must be able to verify all hours charged for machine work. This will apply to work done by contractor or approved subcontractor(s). The hours worked on

City's equipment shall be supported with time cards when applicable to hourly rates. The ORIGINAL time cards shall be submitted with the FINAL invoice.

B.00.42 The City reserves the right to review all payments made to the Contractor by auditing any and all documents associated with this contract over the contract period and two years after expiration of the contract. Subject to such audit, any overpayments shall be recovered from the Contractor.

B.00.43 The Contractor shall be responsible for storage of the submersible pump units and all parts. Any parts lost or damaged while in the possession of the Contractor shall be repaired or replaced at the Contractor's expense.

B.00.44 The base price, before mark-up/discount of parts supplied for this contract is the total cost of the item for which the Contractor shall provide documentation.

B.00.45 **DELETED:**

B.00.46 Upon completion of any repair work the Contractor shall provide to the City, a full set of completed teardown sheets which details the work performed on the unit, test results and data sheets. The Contractor shall also include but is not limited to the electrical, machinist and mechanical report, and winding data report.

B.00.47 The Contractor shall establish and maintain records of the repair and services performed for at least 2 years after contract expires and also at least three (3) years after the pump is returned repaired (EASA AR100-2010, Section 1.3.2 or latest edition).

B.00.48 The repaired unit shall pass inspection and/or test (s) with defined acceptance criteria (EASA AR100-2010, Section 4 or latest edition).

B.00.49 All inspection, cleaning, balancing, disassembly, reassembly, winding, dipping, baking, blasting, painting, testing and document preparation shall be included as part of the base rewind/recondition cost.

B.00.50 **In the event the contractor cannot recondition-repair and rewind-repair motor, the city permits, upon CTR's approval, contractor to purchase from manufacturer, OEM reconditioned or remanufactured motor for its submersible pumps. Non-OEM motor is acceptable upon CTR's approval. The contractor shall furnish the OEM or Non-OEM documentation with FINAL invoice.**

B.00.51 The REWIND-REPAIR cost in the Fees and Costs schedule does not include the cost of bearings, seals, impellers, wear-rings, heaters, broken and damaged parts. The cost of bearings, seals, impellers, wear-rings, heaters, broken and damaged parts are reimbursable, if authorized by the UDR.

B.01 EXPLOSION-PROOF SUBMERSIBLE PUMP UNITS (SUITABLE FOR NEC CLASS I, DIVISION I, GROUP D)

**REPAIR OF UNDERWRITERS LABORATORY (UL) APPROVED EXPLOSION-PROOF SUBMERSIBLE PUMP.
REPAIR OF FACTORY MUTUAL (FM) APPROVED EXPLOSION-PROOF SUBMERSIBLE PUMP.**

- B.01.01 The repair of ***Underwriters Laboratory*** (UL) explosion-proof submersible pumps shall be performed in a UL approved shop by skilled submersible pump mechanics that are familiar with repair practices typical to explosion-proof submersible pumps.
- B.01.02 The repair of ***Factory Mutual*** (FM) explosion-proof submersible pumps shall be performed in a “Factory” approved shop by skilled pump mechanics that are familiar with repair practices typical to explosion-proof submersible pumps.
- B.01.03 Only OEM parts are allowed in the repair of UL explosion-proof units, except for bearings and seals. NO OTHER EXCEPTION.
- B.01.04 Only shafts and seals can be reworked for a repair of UL explosion-proof units.
- B.01.05 Only OEM parts are allowed in the repair of FM explosion-proof units, except for bearings and seals. NO OTHER EXCEPTION.
- B.01.06 Only shafts and seals can be reworked for a repair of FM explosion-proof units.
- B.01.07 Any casted component of the explosion-proof submersible pump unit that is damaged shall be replaced.
- B.01.08 The repaired “UL” unit shall be certified by an UL inspector.
- B.01.09 The shop shall provide the City with a copy of the “UL” re-certification document. The certificate shall bear the UL file number.

B.02 REPAIR AND REPLACEMENT

- B.02.01 The Contractor shall inspect, repair, and/or troubleshoot assemblies and subassemblies of the submersible pumps in lieu of replacement unless the repair cost of the electric submersible pumps exceeds seventy (70) percent of the cost for replacing it with a new item. Generally the seventy (70) percent rule applies, but the City reserves the right to purchase or repair units based on submersible pump economic evaluation and various operational considerations.
- B.02.02 The CTR must approve, in writing, the purchase of a new unit in lieu of repair.
- B.02.03 The Contractor shall obtain three (3) quotes for items estimated to cost more than \$50,000.00, ***when applicable.*** The City of Houston has the option of accepting the lowest and best quote. The COH reserves the right to solicit quotes for replacement items.
 - B.02.03.01 If the equipment is a sole source item, vendor shall obtain a “signed” and date letter from the manufacturer stating so. This letter shall list the sole distributor for the Houston area. The manufacturer’s letter is valid for thirty (30) days.***
- B.02.04 Replacement unit shall be identical to the unit being replaced. If the identical unit is no longer offered by the manufacturer, the replacement unit shall have the same pump performance characteristic as the one being replaced and shall be of the “Highest Efficiency” motor available. Replacement shall be authorized in writing by the CTR.
- B.02.05 The replacement unit must meet the minimum specification requirements and be equal or better in material, craftsmanship, and performance as the replaced pump.
- B.02.06 The replacement unit provided must be able to fit the facilities existing pump mounting and railing system without any required modification to the facility. The City reserves the right to request a specific pump that may require facility modification.
- B.02.07 The Contractor shall use the mark-up or discount in Fees and Costs Exhibit “H” under “Cost to Replace a Unit.

B.02.08 Non-repair cost (Line item 26) is to be used for pumps that are not repaired nor replaced.

B.03 SPECIFIC TASKS AND SCOPE OF WORK

B.03.01 The User Department will deliver or pick up, from the Contractor's facility, submersible pump units. The Contractor shall furnish hoist, crane, etc. for loading and unloading of the unit.

B.03.02 The Contractor shall chemically and mechanically clean all external surfaces, as required.

B.03.03 The Contractor shall perform electrical tests, with measurement recorded in the Teardown Report. These include but are not limited to:

- Insulation resistance to ground, in megohms, of windings and accessories.
- Surge-comparison of winding
- Growler test

B.03.04 The Contractor shall measure insulation resistance to ground of windings and accessories with a 500 Volt megohmmeter (EASA AR100-2010 4.2.1).

B.03.05 In the event that insulation resistance of the windings is below the recommended minimum value, the motor shall be disassembled, and the windings shall be cleaned and dried before surge-comparison testing.

B.03.06 The Contractor shall disassemble submersible pump units and clean all internal parts unless otherwise specified.

B.03.07 The Contractor shall inspect all components of the submersible pump units and all critical areas to determine if clearances are within OEM tolerances, and the parts meet manufacturer's specifications.

B.03.08 The Contractor shall inspect the unit and its shaft for corrosion, erosion, chipping, scoring, and other damages and shall record this observation on the teardown report.

B.03.09 The Contractor shall inspect the rotor shaft for "roundness/runout" and determine if it is within OEM tolerance

B.03.10 The Contractor shall inspect the pump casing, impeller, shaft sleeve, and wear rings for corrosion, erosion, chipping, scoring, and other damages and shall record this observation on the Teardown Report

B.03.11 The Contractor shall inspect the shaft extensions and key seats (keyways). Shaft extensions dimensions shall be checked and shaft must be smooth, polished, and concentric with shaft center.

B.03.12 The Contractor shall inspect each bolt for damaged threads.

B.03.13 Repair shall include sandblasting, welding and machining as required. Other services required of the Contractor shall include Non-Destructive Testing (NDT), chroming and metalizing if and when required.

B.03.14 The core iron, if needed, may be grit blasted with glass beads, walnut shells, corncobs, or similar materials. It shall not be blasted with silica, garnet, or other grits, which may cause shorts between laminations (EASA Tech Note 16).

B.03.15 The Contractor shall determine what parts are to be machined or replaced with new parts. As a minimum the Contractor shall replace all bearings and seals when the original unit was furnished with such items.

B.03.16 Within seven (7) working days the Contractor shall prepare and submit to the UDR a scope of the repair work to be carried out on the unit, which shall include a good faith and detailed cost estimate. This cost estimate shall include a brief description of the work to be performed, cost for new replacement OEM/ **Non-OEM** parts, estimated additional labor hours required for the repair of the unit not covered under rewind/recondition base cost and shall include the estimated time for delivery time of parts and expected completion date of the work.

B.03.17 The UDR will inspect the tear-downed unit, review the Contractor's proposed work scope and cost estimate. If the cost exceeds the budget, the UDR shall revise the scope and have the Contractor submit another cost estimate.

B.03.18 Upon written acceptance of cost estimate by the UDR, The Contractor shall proceed with repairs. The Contractor shall commence to work on the unit and complete the repair within the allocated time for delivery of such item:

B.03.18.1	Submersible Pumps 75 HP and smaller	8weeks
B.03.18.2	Submersible pumps larger than 75 HP	12 weeks

B.03.19 The Contractor shall notify the UDR immediately if the Contractor cannot complete the job within the contractually agreed time period of item B.03.18. The Contractor shall submit to the UDR a detailed explanation for the delay with a new documentation to complete the job. If additional work is required, the Contractor shall submit explanation before commencing the additional work. B.03.20 At all times during the repair process, the Contractor shall maintain the City's equipment in a clean and weather protected storage area.

B.03.21 The rotor assembly shall be checked for total indicated run out and recorded on the rotor information sheet. The check shall be carried out in precision "V-Blocks.

B.03.22 Shaft seal surface, bearing journals, shall be micrometer checked and results shall be recorded on the rotor information sheet.

B.03.23 The critical dimensions of the end bells and bearing housing shall be micrometer checked and recorded on the mechanical inspection sheet.

B.03.24 The above measurements shall be submitted to the UDR, along with the electrical and mechanical data sheets, during the teardown inspection.

B.03.25 Replacement bearings shall have an L₁₀ rating life in accordance with ANSI/AFBMA of at least 40,000 hours. If the L₁₀ rating life of the existing bearing is larger than 40,000 hours, the Contractor shall replace the bearing with the same L₁₀ rating life bearing as the existing one.

B.03.26 The Contractor shall ensure the quality of varnish in the Dip Tank and the VPI system by sampling and testing the varnish in the DIP Tank/VPI system every three months. The Contractor shall have the varnish quality reports available for review by the City Inspection Team and the UDR.

B.03.27 After parts have been repaired, the Contractor shall put together and balance the rotating assembly. The Contractor shall balance the rotor first, and then balance the

- assembled rotor and impeller.
- B.03.28 The Contractor shall reassemble the submersible pump unit seal, paint and test as required.
- B.03.29 Surface of all RECONDITION-REPAIR and REWIND-REPAIR units shall be prepared for painting to white metal finish by blast cleaning to surface preparation standards and specifications (SSPC-SP5).
- B.03.30 Surface of all RECONDITION-REPAIR and REWIND-REPAIR units shall be primed and finished, in an approved paint booth, using the unit manufacturer's standard epoxy painting system:
- The minimum primer coat thickness shall be 3 mils DFT, dry film thickness (DFT).
 - The minimum finish coat thickness shall be 6 mils DFT, dry film thickness (DFT).
- B.03.31 If the manufacturer's "standard epoxy painting" information is not available, the following industrial coating specification for surface of pumps and equipment shall be followed:
- The primer and finish coats shall be two-component, rust-inhibitive, polyamide-cured epoxy coating with a recoatable finish,
 - The prime coat shall be Ameron 38P, Tnemec 69, or equal.
 - The finish coat shall be Ameron 38S, Tnemec 69, or equal.
- B.03.32 Changes to paint specifications (item B.03.29, B.03.30 and B.03.31) shall be approved by the UDR prior to application of paint.
- B.03.33 The user department will specify the paint color.
- B.03.34** **Whenever needed, OEM or approved substitute** specified lube/cooling oils, or equal, shall be used in the oil chamber. The lube/cooling oils shall be biodegradable, nontoxic, and FDA approved.
- B.03.35** **OEM specified greases**, or equal, shall be used in the bearings.
- B.03.36 All electrical work for RECONDITION-REPAIR and REWIND-REPAIR of the units shall be in accordance with Item **B.04 MOTOR INSPECTION AND REPAIR.**

DRINKING WATER OPERATIONS

- B.03.37 Disinfection of pumps for portable water services: Prior to packaging and preparation for return to the city, all repaired or replaced pumping equipment or related parts supplied or otherwise handled or manipulated under this contract- the surfaces of which (interior and exterior) will be in direct contact with portable water (upon return to the City – shall be cleaned, swabbed with a one percent (1%) hypochlorite solution, contact time 10-30 minutes. Then thoroughly rinsed with potable water after completion of contract repairs and/or hydraulic or hydrostatic testing. A separate certificate of disinfection completion, signed by the Contractor shall accompany all affected parts and/or equipment.

B.04 MOTOR INSPECTION AND REPAIR

B.04.01 MOTOR INSPECTION AND REPAIR-GENERAL

- B.04.01.01 The Contractor shall provide a repair data sheet showing the condition of the motor upon receipt, the repair work done and the final test results.
- B.04.01.02 During disassembly, the motor shall be visually inspected to determine cause of

failure, including electrical and/or mechanical failure. Stators shall be removed from the housing.

- B.04.01.03 Stator winding phase to ground insulation shall be checked with a 500 volt megger and the results noted on the inspection form.
- B.04.01.04 Stator winding shall be checked for shorts using surge-comparison tests and all values recorded.
- B.04.01.05 The rotor assembly shall be inspected for wear, scoring and cracks. Checking for open rotor bars shall be done using but not limited to growler and magnetic paper; Enhanced testing of rotor bars can be done using infrared thermography per B.00.05
- B.04.01.06 All stators that are to be rewound shall be core loss tested. This test shall be done after windings are removed and before burnout. The results shall be submitted to the UDR.
- B.04.01.07 Shaft seal surface, bearing journals and coupling fit, shall be checked with a micrometer and recorded on the rotor information sheet.
- B.04.01.08 The insulating material in the rewinding of the unit shall have a Class "F" rating or better.

B.04.02 **MOTOR INSPECTION AND REPAIR-RECONDITION-REPAIR**

- B.04.02.01 Motors that have been designated for winding reconditioning (and have been thoroughly cleaned free from dirt, grit, grease, oil, and properly dried) shall be inspected for winding damage and recommended repairs shall be made to damaged areas upon approval.
- B.04.02.02 Damage to the windings shall be recorded and submitted to the UDR.
- B.04.02.03 Motor insulation shall be washed with hot soapy water at 200 degrees Fahrenheit and at 30 PSI (Pounds per Square Inch) and then with fresh water. After cleaning, unit must be baked between 250 and 275 degrees Fahrenheit until an acceptable insulation level is obtained.
- B.04.02.04 Reconditioned motors shall receive a minimum of two (2) dips and baked in insulating resin. Stator shall be baked at insulation resin manufacturer's recommended temperature and time to assure full curing. Stator shall be removed from housing for this process.

B.04.03 **MOTOR INSPECTION AND REPAIR-REWIND-REPAIR**

- B.04.03.01 The stator core shall be vertically set in the burnout oven. After burnout and winding removal, the core and frame shall be allowed to cool by natural convection without forced air to avoid overstress or warping. Maximum burnout temperature shall be 650 degrees "Fahrenheit" to avoid damage to laminations.
- B.04.03.02 Torch heating shall NOT be used for stator clean up.
- B.04.03.03 The stator core shall be blasted to a bare metal finish. Refer to Item B.03.14 of these specifications for the type of grit permitted for blasting.
- B.04.03.04 The core shall be thoroughly cleaned; the stator core shall be examined for

lamination damage such as fusing or metal loss due to arcing.

- B.04.03.05 Fused laminations shall be separated either by grinding or filing. Bent laminations shall be realigned and all protrusions into the slot area shall be filed or ground smooth. Stator cores shall not be re-stacked without the UDR's approval.
- B.04.03.06 Before a new winding is installed in a stator the winding data shall be verified to assure that an original factory equal winding is being installed. If the manufacturer's data is not available, the winding data shall be verified to assure it conforms to the relevant EASA standard(s).
- B.04.03.07 Coils shall be formed with the same number of turns as the original winding. Resistance of the rewound stator shall be the same as the original winding.
- B.04.03.08 Coils shall be machine wound with sufficient wire tension to obtain freedom from crossovers and uniform cross-section coils.
- B.04.03.09 Stator winding extensions shall be shaped to ensure adequate winding clearance on motor reassemble.
- B.04.03.10 Phase insulation shall be installed between phase coils, prior to coil lacing, to minimize phase-to-phase contact. Separators shall be installed between the top and bottom coil in the core slots.
- B.04.03.11 Pre-formed slot wedges shall be used to secure the winding in the stator slot, with shim material as necessary to assure tightness.
- B.04.03.12 After the winding is complete, a thoroughly inspection shall be performed to ensure the slot insulation overhangs the core slot edges and is not broken or torn at the core slot edges.
- B.04.03.13 All winding and lead connections shall be brazed with a "silver content" rod and insulated with Class "F" insulation or better.
- B.04.03.14 The winding, connections and leads shall be securely laced to form an integral assembly with adequate physical clearance to ground as required by applicable codes and specifications.
- B.04.03.15 All leads brought into the connection box shall be numbered and equipped with a compression lug with NEMA standard bolt hole.
- B.04.03.16 The finished stator winding insulation to ground shall be checked with a 500 Volts megger. The minimum acceptable insulation resistance reading shall be 10 megohms.
- B.04.03.17 The completed stator shall be preheated in a temperature-controlled oven to the varnish manufacturer's recommendation, not to exceed class "F" operating temperature and shall be held at this temperature for one (1) hour.
- B.04.03.18 Stator shall be allowed to cool by natural convection to the temperature required by insulation resin manufacturer prior to being dipped in insulating varnish.
- B.04.03.19 Stator shall be dipped three (3) times in insulating varnish, repeating processes of items B.04.03.17 and B.04.03.18.

- B.04.03.20 Form-wound Rewound stators shall go through ***vacuum pressure impregnation*** VPI.
- B.04.03.21 Baking shall be done in a temperature controlled and force ventilated oven to allow a complete and uniform cure per pump manufacturer's specifications..
- B.04.03.22 Resin shall be completely removed from the stator frame mechanical fit outer paint surfaces, and the inner bore of the stator.

B.05 STANDARD RESPONSE TIMES

- B.05.01 THE Contractor shall be accessible to the City via telephone during normal business hours. The Contractor shall be ready to start work on any unit within twenty-four (24) hours of receiving the call for the service.
- B.05.02 THE Contractor shall be available and accessible to the City via telephone to work overtime and/or emergency per the request of the UDR.
- B.05.03 THE Contractor shall start an emergency job immediately, without scheduling delays, and will not be restricted to normal working hours. The UDR shall coordinate the emergency and overtime work.

B.06 REPAIR TECHNICIANS

- B.06.01 The repair technicians of the Contractor and approved subcontractor shall be qualified and properly trained in recondition and rewind repair of submersible pumps for this contract
- B.06.02 The Contractor shall have at least one senior repair technician with a minimum of five (5) years experience in repair-recondition and repair-rewind of submersible pumps specified in this contract.
- B.06.03 The Contractor shall furnish the resume of the technicians to the City inspection team during the team's visit of the Contractor's and/or approved subcontractor's facility.

B.07 SHOP ACCEPTANCE OF REPAIR

- B.07.01 The UDR shall thoroughly inspect the repaired unit before the performance test can begin. It is the Contractor's responsibility to ensure communication has been established with the UDR for witnessing of the performance test.
- B.07.02 All control sensing devices shall be checked to ensure they meet the OEM specifications. The control sensing devices shall include (but is not limited to) thermal sensors, moisture sensors, and thermistors.
- B.07.03 Insulation resistance test shall be completed before conducting high-potential test using a 500 Volts megohmmeter.
- B.07.04 Perform high-potential test of windings (new or reconditioned) as stated in EASA AR100-2010, Item 4.4 High-Potential Tests.
- B.07.05 No load test run of the submersible pump shall be performed at its highest rated voltage and frequency.
- B.07.06 The submersible pumps unit shall be securely mounted, to a leveled metal base-plate or set on standard rubber isolation pads while vibration readings are taken.

- B.07.07 Vibration level measurements shall be taken on the completely assembled unit at the bearing housings (horizontal, axial and vertical positions) adjacent to the shaft. The vibration level limits set in B.00.37 shall not be exceeded.
- B.07.08 If deficiencies are detected, the repair work shall be rejected and the Contractor shall make the necessary repairs, adjustments or replacements.
- B.07.09 After corrective actions are made, the unit shall go through a new test run before the submersible pump is accepted.
- B.07.10 A typed copy of the Repair Data Sheets covering results of specific tests such as rotor balance, vibration measurement, electrical testing results, mechanical measurements, rewinding data, and final test sheets shall be included with the shipment of all repaired submersible pumps units, per the UDR's request.
- B.07.11 The City shall not make any payment to the Contractor until all corrective actions are made, testing is performed and the equipment repair is accepted.

B.08 SILENCE OF SPECIFICATIONS

The apparent silence of these specifications as to any detail, or apparent omission from it of a detailed description concerning any point, shall be regarded as meaning that only the best commercial practice is to prevail and that only material and workmanship of the finest quality are to be used. All interpretations of these specifications shall be made on the basis of this statement.

B.09 LABOR RATE

The labor rate shall include ALL costs for a qualified person to work on and repair the City equipment including wages, all company benefits, and company profit.

B.10 ADDITIONAL SERVICES

- B.10.01 Prior to commencement of any Additional Services, the Contractor shall submit a written proposal for approval by the CTR describing the work to be done and include a not to exceed estimate of the cost. The proposal shall include as a minimum a list of repairs, sub-contractor(s), schematics(s), design plans and a schedule of the repairs. Additional work shall not be performed without written approval from the CTR.
- B.10.02 Contractor shall perform Additional Services using the unit rates and any applicable markup/discount in Exhibit "H" entitled Fees and Costs of the contract as specified for the type of service provided. If the contract "Fees and Costs schedule does not cover the work needed, the Contractor shall submit detailed cost estimate for such item for review and approval by the CTR. The performance time for any Additional Services shall be mutually agreed upon in writing between the CTR and the Contractor.

B.11 WARRANTIES

- B.11.01 The Contractor shall observe the highest standards of diligence and care in the performance of repair services and shall meticulously follow the standards and procedures required by the equipment manufacturer.
- B.11.02 The Contractor further warrants that all service and replacement parts it provides shall be in strict compliance with all applicable regulations.

B.11.03 The Contractor shall fully warrant installation, replacement, repair and maintenance of all parts and equipment from the date of acceptance by the City of Houston (COH). The Contractor shall include installation, testing of parts and equipment through the contract term and extended one (1) year thereafter. SEE CERTIFICATE OF WARRANTY, DOCUMENT OO1 ATTACHED.

B.11.04 During the warranty period ALL related work shall be started by Contractor within twenty-four (24) hours of delivery and shall be repaired within the previously stated time frame B.03.18.

B.11.05 During the warranty period ALL failed units shall be re-repaired or replaced at the Contractor's expense if failure occurs under normal operating conditions or if the failure is due to faulty parts or negligence of the Contractor.

B.12 **INVOICES**

No later than 30 days after the City accepts and receives the pump, the Contractor shall submit invoices for payment in triplicate (one original and two copies) that are on Contractor's company stationary with the original signed by an authorized agent of the company. In addition, all invoices shall be submitted by May 30th of each fiscal year to ensure payments are paid by the end of each fiscal year. ALL SUPPORT DOCUMENTS SHALL BE ORIGINAL. The invoice number shall not be duplicated during the term of the contract. Each invoice shall include the following information:

B.12.01 The City Contractor Number, City Ordinance Number, City Release Number, and Contractor's Job Number.

B.12.02 The Contractor's Job Number and Contract year shall appear clearly on all time sheets [showing hours worked, break(s) and lunch time], invoices, and suppliers' invoices.

B.12.03 The Contractor's name and address and where the service was performed.

B.12.04 The City equipment EI Number, and City Work Order Number.

B.12.05 The City Facility Number and address where equipment had been prior to service.

B.12.06 Detailed description of services rendered.

B.12.07 Description of parts or components repaired or replaced. Provide part numbers, listing before and after discount. If parts are OEM **or Non-OEM** reconditioned, the costs to recondition parts must be listed as well as the cost of new OEM **or Non-OEM** replacement parts.

B.12.08 The subcontractor's invoices with detail description of work performed, time sheets [showing hours worked, break(s) and lunch time], and cost.

B.12.09 Detail Labor hours and rates as stated in the contract Exhibit "H" entitled "Fees and Costs".

B.12.10 The City delivery and pickup tickets.

B.12.11 UL re-certification for explosion-proof units when applicable

B.12.12 Subtotal costs for recondition/rewind, parts and labor separately.

- B.12.13 Shop Acceptance form, Teardown and Recommended Repair form, UL Certification form (when applicable), Equipment Release Authorization form, Recommended Repair Estimate form, Fits and Indicated Runout form (if requested), Final Acceptance Tests form.
- B.12.14 Total invoice costs of the job.
- B.12.15 A clear indication of the cost of the repair of the unit in a percentage compared to the cost of a new unit.
- B.12.16 The charts for bake and burn and all documentation of the records of every preheating and dipping of insulation varnish shall be submitted when requested.
- B.12.17 All unit prices for labor and parts shall be easily identified utilizing the item number and the quoted contract pricing.

Mail invoices to Accounts Payable:
 City of Houston, Accounts Payable
 P.O. Box 61449
 Houston, Texas 77208-1449.

B.13 Estimated Quantities not Guaranteed

The estimated quantities specified herein are not a guarantee of actual quantities, as the City does not guarantee any particular quantity of submersible pump repair services during the term of this contract. The quantities may vary depending upon the actual needs of the user department. The quantities specified herein are good faith estimates of usage during the term of this contract. Therefore, the City shall not be liable for any contractual agreements/obligations the Contractor enters into based on the City purchasing/requiring all the quantities specified herein.

B.14 Minimum Wage

14.01 The Contractor shall pay all employees a minimum of \$7.25 per hour as per the Federal minimum wage requirement.

14.02 If, during the term of this agreement, there is legislation enacted regarding an increase or increases in the minimum wage law, Contractor may submit a request (s) for increase in the Contract Fees to the City Purchasing Agent for consideration, provided such request is accompanied by documentation as requested by the City Purchasing Agent verifying that only Contractor's employees' salaries* were increased accordingly. The City Purchasing Agent shall consult with the Director before responding to the request.

*Subject to the minimum wage law but not already at the new minimum wage level.

B.15 Additions & Deletions

The City, by written notice from the City Purchasing Agent to the Contractor, at any time during the term of this contract, may add or delete like or similar equipment, supplies, locations and/or services to the list of equipment, supplies, locations, and/or services to be provided. Any such written notice shall take effect on the date stated in the notice from the City. Similar equipment, supplies, services, or locations added to the contract shall be in accordance with the contract specification/scope of services, and the charges or rates for items added shall be the same as specified in the fee schedule. In the event that the additional equipment, supplies, locations and/or services are not identical to the item(s) already under contract, the charges therefor will then be the Contractor's normal and customary charges or rates for the equipment, supplies, locations and/or services classified in the Contract Fees and Costss schedule.

B. 16 Warranty of Services

16.01 *Definitions:* "Acceptance" as used in this clause, means the act of an authorized representative of the City by which the City assumes for itself, approves specific services, as partial or complete performance of the contract.

"Correction" as used in this clause, means the elimination of a defect.

16.02 Notwithstanding inspection and acceptance by the City or any provision concerning the conclusiveness thereof, the Contractor warrants that all services performed under this contract will, at the time of acceptance, be free from defects in workmanship and conform to the requirements of this contract. The City shall give written notice of any defect or nonconformance to the Contractor **within the warranty period from the date of acceptance by the COH and the Contractor**. This notice shall state either (1) that the Contractor shall correct or re-perform any defective or non-confirming services at no additional cost to the City, or (2) that the City does not require correction or re-performance.

16.03 If the Contractor is required to correct or re-perform, it shall be at no cost to the City, and any services corrected or re-performed by the Contractor shall be subject to this clause to the same extent as work initially performed. If the Contractor fails or refuses to correct or re-perform, the City may, by contract or otherwise correct or replace with similar services and charge to the Contractor the cost occasioned to the City thereby, or make an equitable adjustment in the contract price.

16.04 If the City does not require correction or re-performance, the City shall make an equitable adjustment in the contract price.

(REQUIRED FORMS)

B-1

City of Houston

Public Works & Engineering Department

Submersible Pump Repair Service Contract

Teardown and Recommended Repair Report

Sample Only, Actual Form is subject to change by CTR after award of the Contract

Contractor: _____ Contractor Job Number: _____

City Contract #: _____ City Release #: _____ City Ordinance #: _____

Pump Location: _____ City Facility Number: _____ EI #: _____

Nameplate Information:

Make:	Volt:	HP:	RPM:
Model:	Amp:	Hz:	SF:
Serial:	Impeller Code:		

Cable Information:

Power Cable	Size	Length	Condition
Control Cable	Size	Length	Condition

Bearings	DE Size	Condition
Bearings	ODE Size	Condition
Volute		
Wear Rings		
Slide Rail Bracket		
Discharge Face		

Runouts:

Shaft DE	
Shaft ODE	
Face of Rotor	

Stator Megger Test: 5,000 MΩ @500V

Cable Megger Test: 5,000 MΩ @500V

Surge Test: _____

Core Loss Test: _____

Recommendation: Recondition-Repair: _____

Rewind-Repair: _____

Other Repairs Needed: _____

Parts Description: _____

Prepared By: _____ Job Title: _____ Date: _____

City of Houston
Public Works & Engineering Department
Submersible Pump Repair Service

U. L. CERTIFICATION FORM

Sample Only, Actual Form is subject to change by CTR after award of the Contract

NAME OF REPAIR SHOP: _____

FACILITY NAME _____ JOB # _____ EI # _____

OLD U.L. SERIAL # _____ NEW SERIAL # _____

ORIGINAL CLASS _____ ORIGINAL GROUP _____

REBUILT CLASS _____ REBUILT GROUP _____

DATE NEW SERIAL # ISSUED _____

WORK DONE _____

SUBMERSIBLE PUMP MFGR _____ FRAME _____

SUBMERSIBLE PUMP SERIAL # _____

HP _____ VOLTS _____ AMPS _____ CODE _____

INSULATING CLASS _____ THERMOSTAT MOUNTING CODE _____

U.L. INSPECTOR NAME: _____

U.L. INSPECTOR EMPLOYEE #: _____

Shop Acceptance Tests Form

City of Houston

Public Works & Engineering Department
Submersible Pump Repair Service Contract

Sample Only, Actual Form is subject to change by CTR after Award of the Contract

Contractor: _____ Contractor Job #: _____

Contract #: _____ Ordinance #: _____ City Work Order #: _____

City Facility Name: _____ City Facility #: _____ EI #: _____

Nameplate Information:

Make:	Volt:	HP:	RPM:
Model:	Amp:	Hz:	SF:
Serial:	Impeller Code:		

Visual Inspection:

Stator Megger Test: i.e. 5,000 MΩ @500V _____

Cable Megger Test i.e. 5,000 MΩ @500V _____

Hi-Potential Test: _____

Source Voltages	V ₁ =	V ₂ =	V ₃ =
No-Load Currents	I ₁ =	I ₂ =	I ₃ =
Vibration	Axial =	Radial =	Vertical =

Comments and Deficiencies:

Tests Performed By: _____ Job Title: _____ Date: _____

Witnessed By UDR: _____ # _____ Date: _____

Field Acceptance Tests Form

City of Houston

Public Works & Engineering Department
Submersible Pump Repair Service Contract

Sample Only, Actual Form is subject to change by CTR after Award of the Contract

Contractor: _____ Contractor Job #: _____

Contract #: _____ Ordinance #: _____ City Work Order #: _____

City Facility Name: _____ City Facility #: _____ EI #: _____

Nameplate Information:

Make:	Volt:	HP:	RPM:
Model:	Amp:	Hz:	SF:
Serial:	Impeller Code:		

Visual Inspection:

Stator Megger Test: _____

Cable Megger Test: _____

Source Voltages	$V_1 =$	$V_2 =$	$V_3 =$
Run Currents, Closed Valve	$I_1 =$	$I_2 =$	$I_3 =$
Currents, Open Valve, Start	$I_1 =$	$I_2 =$	$I_3 =$
Currents, Open Valve, after 24 hour	$I_1 =$	$I_2 =$	$I_3 =$

Comments and Deficiencies:

Tests Performed By: _____ Job Title: _____ Date: _____

Witnessed By UDR: _____ # _____ Date: _____

Equipment Release Authorization Form
City of Houston
Public Works & Engineering Department
Submersible Pump Repair Service Contract

Sample Only, Actual Form is subject to change by CTR after Award of the Contract

RELEASE #: _____

DATE: _____

CITY WORK ORDER #: _____

CITY FACILITY NAME: _____ CITY FACILITY #: _____ EI #: _____

CONTRACTOR: _____ CONTRACTOR JOB #:

CONTRACTOR ADDRESS: _____

CONTRACT #: _____

ORDINANCE #: _____

NAMEPLATE INFORMATION:

MAKE:	VOLT:	HP:	RPM:
MODEL:	AMP:	HZ:	SF:
SERIAL:	IMPELLER CODE:		

REASON FOR THE PULLING OF THE SUBMERSIBLE PUMP:

NAME OF THE SHOP THE EQUIPMENT IS BEING TAKEN TO:

IS THERE A PICTURE OF THE SUBMERSIBLE ATTACHED? YES: _____ No: _____

CONTRACTOR REPRESENTATIVE

CITY OF HOUSTON REPRESENTATIVE

NAME: _____

NAME: _____

EMPLOYEE #: _____

EMPLOYEE #: _____

SIGNATURE: _____

SIGNATURE: _____

DATE: _____

DATE: _____

COMMENTS: _____

B-6
Recommended Repair Estimate Form
 City of Houston

Public Works & Engineering Department Submersible Pump Repair Service Contract
Sample Only, Actual Form is subject to change by CTR after Award of the Contract

Contract #:	City Work Order #:
Ordinance #:	Contractor Job #:
City Facility:	Facility #:
Submersible Pump:	
Manufacturer:	Work Notification Date:
Voltage: Current: HP: RPM:	Field Inspection Date:
Serial #:	Equipment Pull Date:
El#:	Estimate Date:

UNIT PRICE ITEMS:	Unit	Qty	Extended
	<u>Price</u>		<u>Price</u>
Item 1 - Prepare for Removal – Each		1.00	
Item 2 - Transport to Shop – Each		1.00	
Item 3 - Return to City – Each		1.00	
I. Sub-Total Unit Price Items			

COST PLUS ITEMS:	Contract	Extended
	<u>Cost</u> <u>Mark Up</u>	<u>Price</u>
Item 14 -	1.**	
Item 15	1.**	
Item 15- Work by Sub-contractor (see Original invoices)	1.**	
Item 16 - NDT (see parts worksheet)	1.**	
Item 17 - Parts: (see parts Original Invoices)	1.**	
Item 18 - Rented Crane/Rigging	1.**	
II. Sub-Total Cost Plus Items		

Additional Services (see worksheet):

Total Estimated Project Costs

Total Estimated Submersible Pump Repair Only

Replacement Cost of an Identical Unit

Repair Cost Expressed as % of Replacement Cost

Repair of Submersible Pump Approved by City of Houston:

Signature/Date – Submersible Pump Repair Print Name

FITS AND INDICATED RUNOUT

City of Houston
Public Works & Engineering Department
Electric Motor Repair Service Contract

Sample Only, Actual Form is subject to change by CTR after Award of the Contract


(Horizontal & Vertical Motor)

EI # _____

Horizontal Ball
Bearing Rotor

Fits and Indicated
Runout

Job # _____ 0 _____

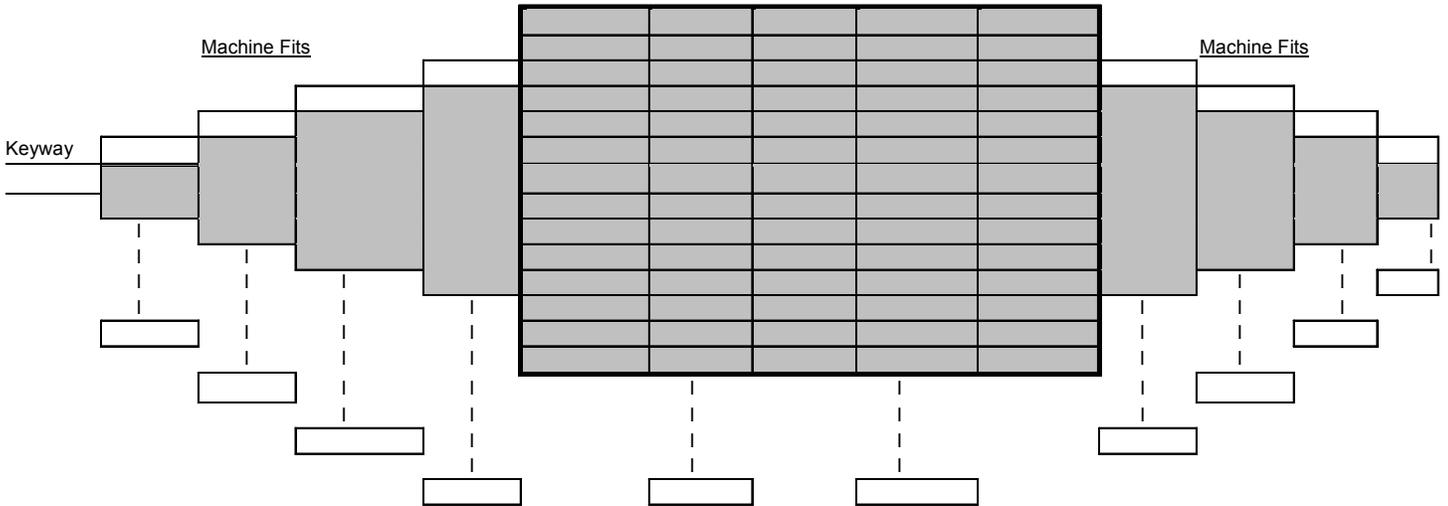

Indicated Run-Out

Indicated Run-Out

Iron Length: _____
 Iron Diam.: _____
 Slot Depth: _____
 Back Iron: _____
 # Vent Holes: _____
 Vent Hole Diam: _____

Make: _____ H.P. _____ Volts: _____
 Model: _____ Amps. _____ Cyc. _____
 R.P.M. _____ Frame: _____ SN: _____

B-8

**Progress and Status Report Form
City of Houston**

Public Works & Engineering Department
Submersible Pump Repair Service Contract

Sample Only. Actual Form is subject to change by CTR after Award of the Contract

Release Number	Work Order #	Work Order Date	E.I. #	Fac. #	Fac. Name	Manufac.	Model #	Serial #	H.P.	Problem	Date In Shop	Shop Job #	Inspect Date	Test Date	Person Called Date	Allocated Amount	Cost Of Repair	Expend. To Date
																\$	\$	\$

Invoice Checklist Report Form

City of Houston
 Public Works & Engineering Department
 Submersible Pump Repair Service Contract

Sample Only, Actual Form is subject to change by CTR after Award of the Contract

INVOICE CHECKLIST

“Company Name” / (Small Submersible Pumps) / Contract # 460000XXXX

a) Facility Name:		Facility #
b) Date:		
c) UDR Review Date:		
Comments:		

Instructions

- 1) Check mark "X" selected items listed below.
- 2) Sign and date at the bottom of form

Item Number	Contract Requirements Description	Contractor Review	UDR Review
1	City Contract Number, and Ordinance Number		
2	Contractor Job Number		
3	Contractor's name and address		
4	Contractor's representative name, signature and date		
5	City facility name, number and address where service was provided		
6	Detailed description of services rendered		
7	Equipment Identification Number		
8	City Equipment Release Number		
9	City Work Order Number		
10	Subcontractor's invoices with description of work performed, hours and parts cost		
11	Detailed labor hours and rates as stated in the "Fee Schedule" (when applicable)		
12	City delivery and pickup tickets		
13	UL Re-certification for explosion-proof units (when applicable)		
14	Subtotal cost for parts and labor separately		
15	Shop Test/Acceptance Form, Teardown and Recommended Repair form, Equipment Release authorization form, Recommended Repair Estimate Form & Final Repair Cost Form		
16	All unit prices for labor and Parts are easily identified against the quoted contract pricing		
17	Invoice charged to correct job #		

 UDR signature

 Date

Document 001

WARRANTY OF INSTALLATION, REPLACEMENT,
REPAIR AND MAINTENANCE

BID NO:
OUTLINE AGREEMENT NO: [No.]

TO: [Contractor's Company Name]
Contractor and [Contractor's Address]
Address for Written Notice

1.01 DATE OF SUBSTANTIAL COMPLETION

The Work performed under the Contract was inspected on [Date inspected], and found to be substantially complete. The Date of Substantial Completion of the Work is hereby established as [Date of Substantial Completion]. This is the start date of Warranty.

1.02 WARRANTY PERIOD

The contractor fully warrants installation, replacement, repair and maintenance of all parts and equipment from the date of acceptance by the City of Houston and the Contractor, which includes installation, testing of parts and equipment through the contract term and extended one (1) year thereafter..

1.07 CONTRACTOR'S ACKNOWLEDGEMENT

Signature of Contractor, or its agent, acknowledges Warranty Work and the terms of Warranty Period referenced under Warranties, Paragraph B.11.03.

_____ Contractor	_____ Signature	_____ Date
_____ CTR, Wastewater	_____ Signature	_____ Date
_____ CTR, Drinking Water	_____ Signature	_____ Date
_____ UDR, Wastewater	_____ Signature	_____ Date
_____ UDR, Drinking Water	_____ Signature	_____ Date

END OF DOCUMENT

SAMPLE PRICING

✚ What Sample Pricing **Is**: Pricing of selected contract bid items/services purchased by the city which allows comparison of vendor’s prices.

✚ What Sample Pricing **Does**: Sample Pricing: allows the city to determine which vendor is offering the best value when compared to their bid price(s).

Sample Pricing shall be provided for each year of the contract, (five-years). The Contractor shall duplicate the pricing form and indicate sample pricing for the proceeding years, (year 2, 3, 4 & 5).

Yr 1 Sample Pricing

Group 1, – Rewind Flygt Pump Model CP-3305

COST	DESCRIPTION	U/M	QTY	UNIT
1.	75 hp and less than or equal to 100 hp	Ea	1	_____

Group 3, -- Flygt Pump – Labor Rates

COST	DESCRIPTION	U/M	QTY	UNIT
1.	Electric Labor Rate	Hr	10	_____

COST	DESCRIPTION	U/M	QTY	UNIT COST/ UNIT	
				OEM PARTS	NON-OEM PARTS

Group 4, -- Flygt Pump, PARTS & MATERIALS (Original Invoice)

1.	Repair Kit, 330. 180 U & L Seal U & L Brgs. O-Ring Kit	Ea	1	_____	_____
2.	Cable, Subcab 7X1.5 16MM 158F	Ea	60	_____	_____
3.	Cable, Subcab 4G50 41-45MM 70C Old #00094 20 49	Ea	60	_____	_____
4.	Grommet 43MM ID 70MM OD	Ea	1	_____	_____
5.	Grommet 17MM ID 35MM OD	Ea	1	_____	_____
6.	O-Ring 239.3X5.7 Nitrile **10	Ea	2	_____	_____
7.	O-Ring 179.3X57 Nitrile **10	Ea	1	_____	_____
8.	Level Switch 700/800/900	Ea.	1	_____	_____
9.	Control Cable Unit	Ea.	1	_____	_____
10.	Wear Ring, Rotating S.S	Ea	1	_____	_____
11.	Wear Ring	Ea	1	_____	_____

Yr 1 Sample Pricing

Group 5, – Recondition, KSB Pump Model KRTE100225174XG202

COST	DESCRIPTION	U/M	QTY	UNIT
	1. 5 hp and less than or equal to 15 hp	Ea	1	_____

COST	DESCRIPTION	U/M	QTY	UNIT COST	UNIT
			OEM PARTS	NON-OEM PARTS	

Group 8, -- KSB Pump, PARTS & MATERIALS (Original Invoice)

1.	Oil	Ea	0.5	_____	_____
2.	Potting Mix	Ea	1	_____	_____
3.	SKF 6305 Sealed	Ea	1	_____	_____
4.	SKF 6309 Sealed	Ea	1	_____	_____
5.	O-Ring Set	Ea	1	_____	_____
6.	33MM Upper Mech. Seal	Ea	1	_____	_____
7.	33MM Lower Mech. Seal	Ea	1	_____	_____
8.	5/16 SCW Pin Shackle	Ea	2	_____	_____
9.	5/16 Gal. Chain	Ea	27	_____	_____
10.	55 ft. Cable 10G 9COND SEOWW	Ea	55	_____	_____

Yr 1 Sample Pricing

Group 10, – Recondition, Myers Pump Model #8VLX600M6-43

COST	DESCRIPTION	U/M	QTY	UNIT
	1. 50 hp and less than or equal to 75 hp	Ea	1	_____

Group 12, -- Myers Pump – Labor Rates,

COST	DESCRIPTION	U/M	QTY	UNIT
	1. Machining Standard Labor Rate	Hr	38	_____

COST	DESCRIPTION	U/M	QTY	UNIT COST	UNIT
			OEM PARTS	NON OEM PARTS	

Group 13, Myers Pump, PARTS & MATERIALS (Original Invoice)

1.	Potting Mix	Ea	2	_____	_____
2.	Fina Diekan Oil	Ea	12	_____	_____
3.	½ 13X2 SS HHCS Bolts	Ea	10	_____	_____
4.	4/4 Power Cable	Ea	90	_____	_____
5.	18/5 Control Cable	Ea	90	_____	_____
6.	6309 Open Bearing	Ea	1	_____	_____
7.	7316 Open Bearing	Ea	1	_____	_____
8.	Upper Bearing Wavy Washer	Ea	1	_____	_____
9.	Isolating Terminals ½ NPT	Ea	7	_____	_____
10.	New Volute	Ea	1	_____	_____
11.	Upper Spring Retainer	Ea	1	_____	_____
12.	Upper & Lower Seals (hard face)	Ea	2	_____	_____
13.	O-Rings	Ea	5	_____	_____
14.	Gasket/Ring Seal	Ea	1	_____	_____

Yr 1 Sample Pricing

Group 15, -- Rewind, Miscellaneous Pump – Fairbank Morse Model V020D2256D

COST	DESCRIPTION	U/M	QTY	UNIT
	1. 30 hp and less than or equal to 50 hp	Ea	1	_____

Group 16, -- Miscellaneous Pump-- Labor Rates

COST	DESCRIPTION	U/M	QTY	UNIT
	1. UL Re-Certification	Hr	1	_____
	2. Machining	Hr	26	_____

COST	DESCRIPTION	U/M	QTY	UNIT COST		UNIT
				OEM PARTS	NON-OEM PARTS	

Group 17, -- PARTS & MATERIALS (Original Invoice)

1.	Impeller	Ea	1	_____	_____
2.	Impeller Cap Screws	Ea	1	_____	_____
3.	Impeller Washer	Ea	1	_____	_____
4.	Front Head Wear Ring	Ea	1	_____	_____
5.	Impeller Key	Ea	1	_____	_____

6.	Volute Gasket	Ea	1	_____	_____
7.	Impeller Shim	Ea	7	_____	_____
8.	Motor O-Ring Kit	Ea	1	_____	_____
9.	Resistor	Ea	1	_____	_____
10.	Circulator	Ea	1	_____	_____
11.	Terminal Board Assy	Ea	1	_____	_____
12.	Radial Bearing	Ea	1	_____	_____
13.	Thrust Bearing	Ea	1	_____	_____
14.	Inner Mechanical Seal	Ea	1	_____	_____
15.	Outer Mechanical Seal	Ea	1	_____	_____
16.	Gland Seal	Ea	1	_____	_____
17.	Sator Housing	Ea	1	_____	_____

END OF DOCUMENT

**SECTION C
GENERAL TERMS & CONDITIONS**

THE STATE OF TEXAS

BID # _____

COUNTY OF HARRIS

ORDINANCE # _____

CONTRACT # _____

IV. PARTIES

1.0 ADDRESS

THIS AGREEMENT for _____ ("Agreement") is made on the Countersignature Date between the **CITY OF HOUSTON, TEXAS** ("City"), a municipal corporation and _____ ("Contractor or Vendor"), a a Texas Home-Rule City doing business in Texas.

The initial addresses of the parties, which one party may change by giving written notice to the other party, are as follows:

City

City Purchasing Agent for Director
of the (insert Department Name here)
City of Houston
P.O. Box 1562
Houston, Texas 77251

Contractor

Phone: _____
Fax: _____

The Parties agree as follows:

2.0 TABLE OF CONTENTS

2.1 This Agreement consists of the following sections:

TABLE OF CONTENTS

Page No.

I.	PARTIES	40
1.0	ADDRESS	40
2.0	TABLE OF CONTENTS.....	40
3.0	PARTS INCORPORATED	42
4.0	CONTROLLING PARTS	42
5.0	DEFINITIONS	42
6.0	SIGNATURES	43
II.	DUTIES OF CONTRACTOR	44
1.0	SCOPE OF WORK/SPECIFICATIONS.....	44
2.0	RELEASE	44
3.0	INDEMNIFICATION	44
4.0	INDEMNIFICATION PROCEDURES.....	45
5.0	INSURANCE.....	45
6.0	WARRANTIES	46
7.0	LICENSES AND PERMITS.....	46
8.0	COMPLIANCE WITH EQUAL OPPORTUNITY ORDINANCE	46
9.0	MWBE COMPLIANCE	46
10.0	DRUG ABUSE DETECTION AND DETERRENCE	47
11.0	ENVIRONMENTAL LAWS.....	47
12.0	CITY’S CONTRACTOR PAY OR PLAY PROGRAM.....	48
13.0	CONTRACTOR’S PERFORMANCE	48
14.0	PAYMENT OF EMPLOYEES AND SUBCONTRACTORS.....	48
III.	DUTIES OF CITY.....	48
1.0	PAYMENT TERMS	48
2.0	TAXES	49
3.0	METHOD OF PAYMENT	49
4.0	METHOD OF PAYMENT - DISPUTED PAYMENTS	49
5.0	LIMIT OF APPROPRIATION:	49
6.0	CHANGES	50
IV.	TERM AND TERMINATION	51
1.0	CONTRACT TERM.....	51
2.0	NOTICE TO PROCEED.....	51
3.0	RENEWALS.....	51
4.0	TIME EXTENSIONS	51
5.0	TERMINATION FOR CONVENIENCE BY THE CITY	51
6.0	TERMINATION FOR CAUSE BY CITY	52
7.0	TERMINATION FOR CAUSE BY CONTRACTOR	52
8.0	REMOVAL OF CONTRACTOR OWNED EQUIPMENT AND MATERIALS	52
V.	MISCELLANEOUS	53
1.0	INDEPENDENT CONTRACTOR.....	53
2.0	FORCE MAJEURE	53
3.0	SEVERABILITY	53
4.0	ENTIRE AGREEMENT	53
5.0	WRITTEN AMENDMENT	53
6.0	APPLICABLE LAWS.....	53

7.0	NOTICES	54
8.0	NON-WAIVER	54
9.0	INSPECTIONS AND AUDITS	54
10.0	ENFORCEMENT	54
11.0	AMBIGUITIES	54
12.0	SURVIVAL	54
13.0	PARTIES IN INTEREST	55
14.0	SUCCESSORS AND ASSIGNS	55
15.0	BUSINESS STRUCTURE AND ASSIGNMENTS	55
16.0	REMEDIES CUMULATIVE	55
17.0	CONTRACTOR DEBT	55

EXHIBITS

- A. DEFINITIONS
- * B. SCOPE OF WORK/SPECIFICATIONS
- * C. EQUAL EMPLOYMENT OPPORTUNITY
- * D. MWBE SUBCONTRACT TERMS
- * E. DRUG POLICY COMPLIANCE AGREEMENT
- F. CERTIFICATION OF NO SAFETY IMPACT POSITIONS
- * G. DRUG POLICY COMPLIANCE DECLARATION
- * H. FEES AND COSTS
- * I. CITY'S CONTRACTORS PAY OR PLAY PROGRAM

* Note: These Exhibits shall be inserted into the Contract agreement at the time of Contract execution.

3.0 PARTS INCORPORATED

3.1 The above described sections and exhibits are incorporated into this Agreement.

4.0 CONTROLLING PARTS

4.1 If a conflict among the sections or exhibits arises, the Exhibits control over the Sections.

5.0 DEFINITIONS

5.1 Certain terms used in this Agreement are defined in Exhibit "A".

6.0 SIGNATURES

6.1 The Parties have executed this Agreement in multiple copies, each of which is an original.

ATTEST/SEAL: (if a corporation)
WITNESS: (if not corporation)

By: _____
Name:
Title:

By: _____
Name:
Title:
Federal Tax ID Number: _____

ATTEST/SEAL:

CITY OF HOUSTON, TEXAS
Signed by:

City Secretary

Mayor

APPROVED:

COUNTERSIGNED BY:

City Purchasing Agent

City Controller

DATE COUNTERSIGNED:

This Contract has been reviewed as to form by the undersigned legal assistant and has been found to meet established Legal Department criteria. The Legal Department has not reviewed the content of these documents.

Date

Legal Assistant

V. DUTIES OF CONTRACTOR

1.0 SCOPE OF SERVICES

- 1.1 In consideration of the payments specified in this Agreement, Contractor shall provide all supervision, labor, tools, equipment, permits, parts, expendable items, material, and supplies necessary to perform the services described in Exhibit "B" entitled Scope of Work/Specifications.

2.0 RELEASE

- 2.1 PRIME CONTRACTOR/SUPPLIER AGREES TO AND SHALL RELEASE THE CITY, ITS AGENTS, EMPLOYEES, OFFICERS, AND LEGAL REPRESENTATIVES (COLLECTIVELY THE CITY) FROM ALL LIABILITY FOR INJURY, DEATH, DAMAGE, OR LOSS TO PERSONS OR PROPERTY SUSTAINED IN CONNECTION WITH OR INCIDENTAL TO PERFORMANCE UNDER THIS AGREEMENT, EVEN IF THE INJURY, DEATH, DAMAGE, OR LOSS IS CAUSED BY THE CITY'S SOLE OR CONCURRENT NEGLIGENCE AND/OR THE CITY'S STRICT PRODUCTS LIABILITY OR STRICT STATUTORY LIABILITY.

3.0 INDEMNIFICATION

- 3.1 PRIME CONTRACTOR/SUPPLIER AGREES TO AND SHALL DEFEND, INDEMNIFY, AND HOLD THE CITY, ITS AGENTS, EMPLOYEES, OFFICERS, AND LEGAL REPRESENTATIVES (COLLECTIVELY "THE CITY") HARMLESS FOR ALL CLAIMS, CAUSES OF ACTION, LIABILITIES, FINES, AND EXPENSES (INCLUDING, WITHOUT LIMITATION, ATTORNEY'S FEES, COURT COSTS, AND ALL OTHER DEFENSE COSTS AND INTEREST) FOR INJURY, DEATH, DAMAGE, OR LOSS TO PERSONS OR PROPERTY SUSTAINED IN CONNECTION WITH OR INCIDENTAL TO PERFORMANCE UNDER THIS AGREEMENT INCLUDING, WITHOUT LIMITATION, THOSE CAUSED BY:
 - 3.1.1 PRIME CONTRACTOR/SUPPLIER AND/OR ITS AGENTS', EMPLOYEES', OFFICERS', DIRECTORS', CONTRACTORS', OR SUBCONTRACTORS' (COLLECTIVELY IN NUMBERED PARAGRAPHS 2.1-3.2, "CONTRACTOR") ACTUAL OR ALLEGED NEGLIGENCE OR INTENTIONAL ACTS OR OMISSIONS;
 - 3.1.2 THE CITY'S AND PRIME CONTRACTOR/SUPPLIER ACTUAL OR ALLEGED CONCURRENT NEGLIGENCE, WHETHER CONTRACTOR IS IMMUNE FROM LIABILITY OR NOT; AND
 - 3.1.3 THE CITY'S AND PRIME CONTRACTOR/SUPPLIER ACTUAL OR ALLEGED STRICT PRODUCTS LIABILITY OR STRICT STATUTORY LIABILITY, WHETHER CONTRACTOR IS IMMUNE FROM LIABILITY OR NOT.
 - 3.1.4 PRIME CONTRACTOR/SUPPLIER SHALL DEFEND, INDEMNIFY, AND HOLD THE CITY HARMLESS DURING THE TERM OF THIS CONTRACT AND FOR FOUR YEARS AFTER THE CONTRACT TERMINATES. CONTRACTOR'S INDEMNIFICATION IS LIMITED TO \$500,000.00 PER OCCURRENCE. CONTRACTOR SHALL NOT INDEMNIFY THE CITY FOR THE CITY'S SOLE NEGLIGENCE.
- 3.2 CONTRACTOR SHALL REQUIRE ALL OF ITS SUBCONTRACTORS (AND THEIR SUBCONTRACTORS) TO RELEASE AND INDEMNIFY THE CITY TO THE SAME EXTENT AND IN SUBSTANTIALLY THE SAME FORM AS ITS RELEASE AND INDEMNITY TO THE CITY.

4.0 INDEMNIFICATION PROCEDURES

- 4.1 Notice of Claims. If the City or Prime Contractor/Supplier receives notice of any claim or circumstances, which could give rise to an indemnified loss, the receiving party shall give written notice to the other party within 10 days. The notice must include the following:
- 4.1.1 a description of the indemnification event in reasonable detail, and
 - 4.1.2 the basis on which indemnification may be due and
 - 4.1.3 the anticipated amount of the indemnified loss.
- 4.2 This notice does not stop or prevent the City from later asserting a different basis for indemnification or a different amount of indemnified loss than that indicated in the initial notice. If the City does not provide this notice within the 10 day period, it does not waive any right to indemnification except to the extent that Prime Contractor/Supplier is prejudiced, suffers loss, or incurs expense because of the delay.
- 4.3 Defense of Claims
- 4.3.1 Assumption of Defense. Prime Contractor/Supplier may assume the defense of the claim at its own expense with counsel chosen by it that is reasonably satisfactory to the City. Prime Contractor/Supplier shall then control the defense and any negotiations to settle the claim. Within 10 days after receiving written notice of the indemnification request, Prime Contractor/Supplier must advise the City as to whether or not it will defend the claim. If Prime Contractor/Supplier does not assume the defense, the City shall assume and control the defense, and all defense expenses constitute an indemnification loss.
 - 4.3.2 Continued Participation. If Prime Contractor/Supplier elects to defend the claim, the City may retain separate counsel to participate in (but not control) the defense and to participate in (but not control) any settlement negotiations. Prime Contractor/Supplier may settle the claim without the consent or agreement of the City, unless it (i) would result in injunctive relief or other equitable remedies or otherwise require the City to comply with restrictions or limitations that adversely affect the City, (ii) would require the City to pay amounts that Prime Contractor/Supplier does not fund in full, (iii) would not result in the City's full and complete release from all liability to the plaintiffs or claimants who are parties to or otherwise bound by the settlement.

5.0 INSURANCE

- 5.1 Contractor shall maintain in effect certain insurance coverage and shall furnish certificates of insurance, in duplicate form, before beginning its performance under this Agreement. All policies except Professional Liability and Workers' Compensation must name the City as an additional insured. The issuer of any policy (1) shall have a Certificate of Authority to transact insurance business in Texas or (2) shall be an eligible non-admitted insurer in the State of Texas and have a Best's rating of at least B+ and a Best's Financial Size Category of Class VI or better, according to the most current edition Best's Key Rating Guide. Contractor shall maintain the following insurance coverage in the following amounts:
- 5.1.1 Commercial General Liability insurance including Contractual Liability insurance:
\$500,000 per occurrence; \$1,000,000 aggregate
 - 5.1.2 Workers' Compensation including Broad Form All States endorsement:
Statutory amount
 - 5.1.3 Automobile Liability insurance
\$1,000,000 combined single limit per occurrence

Defense costs are excluded from the face amount of the policy
Aggregate Limits are per 12-month policy period unless otherwise indicated

5.1.4 Employer's Liability

Bodily injury by accident \$100,000 (each accident)
Bodily injury by disease \$100,000 (policy limit)
Bodily injury by disease \$100,000 (each employee)

5.2 All insurance policies must require on their face, or by endorsement, that the insurance carrier waives any rights of subrogation against the City, Contractor shall give 30 days' written notice to the Director if any of its insurance policies are cancelled, materially changed or non-renewed. Within the 30 day period, Contractor shall provide other suitable policies in lieu of those about to be canceled, materially changed, or non-renewed so as to maintain in effect the required coverage. If Contractor does not comply with this requirement, the Director, at his or sole discretion, may:

5.2.1 immediately suspend Contractor from any further performance under this Agreement and begin procedures to terminate for default, or

5.2.2 purchase the required insurance with City funds and deduct the cost of the premiums from amounts due to Contractor under this Agreement.

6.0 WARRANTIES

6.1 Contractor represents and warrants that it shall perform all work in a good and workmanlike manner, meeting the standards of quality prevailing in Harris County, Texas for work of this kind. Contractor shall perform all work using trained and skilled persons having substantial experience performing the work required under this Agreement.

6.2 With respect to any parts and goods furnished by it, Contractor warrants:

6.2.1 that all items are free of defects in title, material, and workmanship,

6.2.2 that each item meets or exceeds the manufacturer's specifications and requirements for the equipment, structure, or other improvement in which the item is installed,

6.2.3 that each replacement item is new in accordance with original equipment manufacturers specifications, and of a quality at least as good as the quality of the item which it replaces (when the replaced item was new), and

6.2.4 that no item or its use infringes any patent, copyright, or proprietary right.

7.0 LICENSES AND PERMITS

7.1 Contractor shall obtain and pay for all licenses, permits, and certificates required by any statute, ordinance, rule, or regulation.

8.0 COMPLIANCE WITH EQUAL OPPORTUNITY ORDINANCE

8.1 Contractor shall comply with the City's Equal Employment Opportunity Ordinance as set out in Exhibit "C".

9.0 MWBE COMPLIANCE

9.1 Contractor shall comply with the City's Minority and Women Business Enterprise ("MWBE") programs as set out in Chapter 15, Article V of the City of Houston Code of Ordinances.

Contractor shall make good faith efforts to award subcontracts or supply agreements in at least 7% of the value of this Agreement to MWBEs. Contractor acknowledges that it has reviewed the requirements for good faith efforts on file with the City's Affirmative Action Division and will comply with them.

- 9.2 Contractor shall require written subcontracts with all MWBE subcontractors and shall submit all disputes with MWBEs to binding arbitration in Houston, Texas if directed to do so by the Affirmative Action Division Director. MWBE subcontracts must contain the terms set out in Exhibit "D". If Contractor is an individual person (as distinguished from a corporation, partnership, or other legal entity), and the amount of the subcontract is \$50,000 or less, the subcontract must also be signed by the attorneys of the respective parties.

10.0 DRUG ABUSE DETECTION AND DETERRENCE

- 10.1 It is the policy of the City to achieve a drug-free workforce and workplace. The manufacture, distribution, dispensation, possession, sale, or use of illegal drugs or alcohol by contractors while on City Premises is prohibited. Contractor shall comply with all the requirements and procedures set forth in the Mayor's Drug Abuse Detection and Deterrence Procedures for Contractors, Executive Order No. 1-31 ("Executive Order"), which is incorporated into this Agreement and is on file in the City Secretary's Office.
- 10.2 Before the City signs this Agreement, Contractor shall file with the Contract Compliance Officer for Drug Testing ("CCODT"):
- 10.2.1 a copy of its drug-free workplace policy,
 - 10.2.2 the Drug Policy Compliance Agreement substantially in the form set forth in Exhibit "E", together with a written designation of all safety impact positions, and
 - 10.2.3 if applicable (e.g. no safety impact positions), the Certification of No Safety Impact Positions, substantially in the form set forth in Exhibit "F".
- 10.3 If Contractor files a written designation of safety impact positions with its Drug Policy Compliance Agreement, it also shall file every 6 months during the performance of this Agreement or on completion of this Agreement if performance is less than 6 months, a Drug Policy Compliance Declaration in a form substantially similar to Exhibit "G". Contractor shall submit the Drug Policy Compliance Declaration to the CCODT within 30 days of the expiration of each 6-month period of performance and within 30 days of completion of this Agreement. The first 6-month period begins to run on the date the City issues its Notice to Proceed or if no Notice to Proceed is issued, on the first day Contractor begins work under this Agreement.
- 10.4 Contractor also shall file updated designations of safety impact positions with the CCODT if additional safety impact positions are added to Contractor's employee work force.
- 10.5 Contractor shall require that its subcontractors comply with the Executive Order, and Contractor shall secure and maintain the required documents for City inspection.

11.0 ENVIRONMENTAL LAWS

- 11.1 Contractor shall comply with all rules, regulations, statutes, or orders of the Environmental Protection Agency ("EPA"), the Texas Commission on Environmental Quality ("TCEQ"), and any other governmental agency with the authority to promulgate environmental rules and regulations ("Environmental Laws"). Contractor shall promptly reimburse the City for any fines or penalties levied against the City because of Contractor's failure to comply.

11.2 Contractor shall not possess, use, generate, release, discharge, store, dispose of, or transport any Hazardous Materials on, under, in, above, to, or from the site except in strict compliance with the Environmental Regulations. "Hazardous Materials" means any substances, materials, or wastes that are or become regulated as hazardous or toxic substances under any applicable federal, state, or local laws, regulations, ordinances, or orders. Contractor shall not deposit oil, gasoline, grease, lubricants or any ignitable or hazardous liquids, materials, or substances in the City's storm sewer system or sanitary sewer system or elsewhere on City Property in violation of the Environmental Laws.

12.0 CITY'S CONTRACTOR PAY OR PLAY PROGRAM

12.1 The requirement and terms of the City of Houston Pay or Play Policy, as set out in Executive Order 1-7, are incorporated into this Agreement for all purposes. Contractor has reviewed Executive Order 1-7 and shall comply with its terms and conditions as they are set out at the time of City Council approval of this Agreement.

12.2 The Pay or Play Program for various departments will be administered by the City of Houston Affirmative Action Division's designee and for a Department specific contract; the Department's designated contract administrator will administer the Pay or Play Program.

13.0 CONTRACTOR'S PERFORMANCE

13.1 Contractor shall make citizen satisfaction a priority in providing services under this Agreement. Contractor shall train its employees to be customer service-oriented and to positively and politely interact with citizens when performing contract services. Contractor's employees shall be clean, courteous, efficient, and neat in appearance and committed to offering the highest quality of service to the public. If, in the Director's opinion, Contractor is not interacting in a positive and polite manner with citizens, he or she shall direct Contractor to take all remedial steps to conform to these standards.

14.0 PAYMENT OF EMPLOYEES AND SUBCONTRACTORS

14.1 Contractor shall make timely payments in accordance with applicable state and federal law to all persons and entities supplying labor, materials or equipment for the performance of this Agreement including Contractor's employees.

14.2 Failure of Contractor to pay its employees as required by law shall constitute a default under this contract for which the Contractor and its surety shall be liable on Contractor's performance bond if Contractor fails to cure the default as provided under this Agreement.

14.3 Contractor shall defend and indemnify the City from any claims or liability arising out of Contractor's failure to pay its subcontractors as required by law. Contractor shall submit disputes relating to payment of M/WBE subcontractors to arbitration in the same manner as any other disputes under the M/WBE subcontract.

VI. DUTIES OF CITY

1.0 PAYMENT TERMS

1.1 The City shall pay and Contractor shall accept fees provided in Exhibit "H" for all services rendered and the Deliverables furnished by Contractor. The fees must only be paid from Allocated Funds, as provided below.

2.0 TAXES

- 2.1 The City is exempt from payment of Federal Excise and Transportation Tax and Texas Limited Sales and Use Tax. Contractor's invoices to the City must not contain assessments of any of these taxes. The Director will furnish the City's exemption certificate and federal tax identification number to Contractor if requested.

3.0 METHOD OF PAYMENT

- 3.1 The City shall pay Contractor on the basis of invoices submitted by Contractor and approved by the Director, showing the specific tasks completed in the preceding month and the corresponding prices. The City shall make payments to Contractor at its address for notices within 30 days of receipt of an approved invoice.

4.0 METHOD OF PAYMENT - DISPUTED PAYMENTS

- 4.1 If the City disputes any items in an invoice Contractor submits for any reason, including lack of supporting documentation, the Director shall temporarily delete the disputed item and pay the remainder of the invoice. The Director shall promptly notify Contractor of the dispute and request remedial action. After the dispute is settled, Contractor shall include the disputed amount on a subsequent regularly scheduled invoice or on a special invoice for the disputed item only.

5.0 LIMIT OF APPROPRIATION:

- 5.1 The City's duty to pay money to Contractor under this Agreement is limited in its entirety by the provisions of this Section.
- 5.2 In order to comply with Article II, Sections 19 and 19a of the City's Charter and Article XI, Section 5 of the Texas Constitution, the City has appropriated and allocated the sum of \$ [REDACTED] to pay money due under this Agreement (the "Original Allocation"). The executive and legislative officers of the City, in their discretion, may allocate supplemental funds for this Agreement, but they are not obligated to do so. Therefore, the parties have agreed to the following procedures and remedies:
- 5.3 The City makes a Supplemental Allocation by issuing to Contractor a Service Release Order, or similar form approved by the City Controller, containing the language set out below. When necessary, the Supplemental Allocation shall be approved by motion or ordinance of City Council.

"NOTICE OF SUPPLEMENTAL ALLOCATION OF FUNDS"

"By the signature below, the City Controller certifies that, upon the request of the responsible director, the supplemental sum set out below has been allocated for the purposes of the Agreement out of funds appropriated for this purpose by the City Council of the City of Houston. This supplemental allocation has been charged to such appropriation."

- 5.4 The Original Allocation plus all supplemental allocations are the Allocated Funds. The City shall never be obligated to pay any money under this Agreement in excess of the Allocated Funds. Contractor must assure itself that sufficient allocations have been made to pay for services it provides. If Allocated Funds are exhausted, Contractor's only remedy is suspension or termination of its performance under this Agreement and it has no other remedy in law or in equity against the City and no right to damages of any kind.

6.0 **CHANGES**

6.1 At any time during the Agreement Term, the City Purchasing Agent or Director may issue a Change Order to increase or decrease the scope of services or change plans and specifications, as he or she may find necessary to accomplish the general purposes of this Agreement. Contractor shall furnish the services or deliverables in the Change Order in accordance with the requirements of this Agreement plus any special provisions, specifications, or special instructions issued to execute the extra work.

6.2 The City Purchasing Agent or Director will issue the Change Order in substantially the following form:

CHANGE ORDER

TO: [Name of Contractor]
FROM: City of Houston, Texas (the "City")
DATE: [Date of Notice]
SUBJECT: Change Order under the Agreement between the City and [Name of Contractor] countersigned by the City Controller on [Date of countersignature of the Agreement]

Subject to all terms and conditions of the Agreement, the City requests that Contractor provide the following:

[Here describe the additions to or changes to the equipment or services and the Change Order Charges applicable to each.]

Signed:
[Signature of City Purchasing Agent or Director]

6.3 The City Purchasing Agent or Director may issue more than one Change Order, subject to the following limitations:

6.3.1 Council expressly authorizes the City Purchasing Agent or Director to approve a Change Order of up to \$25,000. A Change Order of more than \$25,000 over the approved contract amount must be approved by the City Council.

6.3.2 If a Change Order describes items that Contractor is otherwise required to provide under this Agreement, the City is not obligated to pay any additional money to Contractor.

6.3.3 The total of all Change Orders issued under this section may not increase the Original Agreement amount by more than 25%.

6.4 Whenever Contractor receives a Change Order, Contractor shall furnish all material, equipment, and personnel necessary to perform the work described in the Change Order. Contractor shall complete the work within the time prescribed. If no time for completion is prescribed, Contractor shall complete the work within a reasonable time. If the work described in any Change Order causes an unavoidable delay in any other work Contractor is required to perform under this Agreement, Contractor may request a time extension for the completion of the work. The City Purchasing Agent's or Director's decision regarding a time extension is final.

6.5 A product or service provided under a Change Order is subject to inspection, acceptance, or rejection in the same manner as the work described in the Original Agreement, and is subject to the terms and conditions of the Original Agreement as if it had originally been a part of the

Agreement.

6.6 Change Orders are subject to the Allocated Funds provisions of this Agreement.

VII. TERM AND TERMINATION

1.0 CONTRACT TERM

1.1 This Agreement is effective on the Countersignature Date and expires three (3) years after the starting date specified in the Notice to Proceed unless sooner terminated according to the terms of this Agreement.

2.0 NOTICE TO PROCEED

2.1 Contractor shall begin performance under this Agreement on the date specified in a Notice to Proceed from the City Purchasing Agent.

3.0 RENEWALS

3.1 Upon expiration of the Initial Term, and so long as the City makes sufficient supplemental allocations, this Agreement will be automatically renewed for two successive one-year terms on the same terms and conditions. If the Director/Chief of the City Department elects not to renew this Agreement, the City Purchasing Agent shall notify Contractor in writing of non-renewal at least 30 days before the expiration of the then current term.

4.0 TIME EXTENSIONS

4.1 If Department requests an extension of time to complete its performance, then the City Purchasing Agent may, in his or her sole discretion, extend the time so long as the extension does not exceed 90 days. The extension must be in writing but does not require amendment of this Agreement. Contractor is not entitled to damages for delay(s) regardless of the cause of the delay(s).

5.0 TERMINATION FOR CONVENIENCE BY THE CITY

5.1 The City Purchasing Agent or Director may terminate this Agreement at any time by giving 30 days written notice to Contractor. The City's right to terminate this Agreement for convenience is cumulative of all rights and remedies, which exist now or in the future.

5.2 On receiving the notice, Contractor shall, unless the notice directs otherwise, immediately discontinue all services under this Agreement and cancel all existing orders and subcontracts that are chargeable to this Agreement. As soon as practicable after receiving the termination notice, Contractor shall submit an invoice showing in detail the services performed under this Agreement up to the termination date. The City shall then pay the fees to Contractor for services actually performed, but not already paid for, in the same manner as prescribed in Section III unless the fees exceed the allocated funds remaining under this Agreement.

5.3 TERMINATION OF THIS AGREEMENT AND RECEIPT OF PAYMENT FOR SERVICES RENDERED ARE CONTRACTOR'S ONLY REMEDIES FOR THE CITY'S TERMINATION FOR CONVENIENCE, WHICH DOES NOT CONSTITUTE A DEFAULT OR BREACH OF THIS AGREEMENT. CONTRACTOR WAIVES ANY CLAIM (OTHER THAN ITS CLAIM FOR PAYMENT AS SPECIFIED IN THIS SECTION), IT MAY HAVE NOW OR IN THE FUTURE FOR FINANCIAL LOSSES OR OTHER DAMAGES RESULTING FROM THE

CITY'S TERMINATION FOR CONVENIENCE.

6.0 TERMINATION FOR CAUSE BY CITY

- 6.1 If Contractor defaults under this Agreement, the City Purchasing Agent or Director may either terminate this Agreement or allow Contractor to cure the default as provided below. The City's right to terminate this Agreement for Contractor's default is cumulative of all rights and remedies, which exist now or in the future. Default by Contractor occurs if:
- 6.1.1 Contractor fails to perform any of its duties under this Agreement;
 - 6.1.2 Contractor becomes insolvent;
 - 6.1.3 all or a substantial part of Contractor's assets are assigned for the benefit of its creditors; or
 - 6.1.4 a receiver or trustee is appointed for Contractor.
- 6.2 If a default occurs, the City Purchasing Agent or Director may, but is not obligated to, deliver a written notice to Contractor describing the default and the termination date. The City Purchasing Agent or Director, at his or her sole option, may extend the termination date to a later date. If the City Purchasing Agent or Director allows Contractor to cure the default and Contractor does so to the City Purchasing Agent's or Director's satisfaction before the termination date, then the termination is ineffective. If Contractor does not cure the default before the termination date, then the City Purchasing Agent or Director may terminate this Agreement on the termination date, at no further obligation of the City.
- 6.3 To effect final termination, the City Purchasing Agent or Director must notify Contractor in writing. After receiving the notice, Contractor shall, unless the notice directs otherwise, immediately discontinue all services under this Agreement, and promptly cancel all orders or subcontracts chargeable to this Agreement.

7.0 TERMINATION FOR CAUSE BY CONTRACTOR

- 7.1 Contractor may terminate its performance under this Agreement only if the City defaults and fails to cure the default after receiving written notice of it. Default by the City occurs if the City fails to perform one or more of its material duties under this Agreement. If a default occurs and Contractor wishes to terminate the Agreement, then Contractor must deliver a written notice to the Director describing the default and the proposed termination date.
- 7.2 The date must be at least 30 days after the Director receives notice. Contractor, at its sole option, may extend the proposed termination date to a later date. If the City cures the default before the proposed termination date, then the proposed termination is ineffective. If the City does not cure the default before the proposed termination date, then Contractor may terminate its performance under this Agreement on the termination date.

8.0 REMOVAL OF CONTRACTOR OWNED EQUIPMENT AND MATERIALS

- 8.1 Upon expiration, or termination of this Agreement, Contractor is permitted ten (10) days within which to remove contractor-owned material and equipment from the City's premises. The City shall make such material and equipment readily available to Contractor. The time period may be extended upon approval by the Director. The City reserves the right to deny any extension of time.

VIII. MISCELLANEOUS

1.0 INDEPENDENT CONTRACTOR

- 1.1 Contractor shall perform its obligations under this Agreement as an independent contractor and not as an employee of the City.

2.0 FORCE MAJEURE

- 2.1 Timely performance by both parties is essential to this Agreement. However, neither party is liable for delays or other failures to perform its obligations under this Agreement to the extent the delay or failure is caused by Force Majeure. Force Majeure means fires, floods, explosions, and other acts of God, war, terrorist acts, riots, court orders, and the acts of superior governmental or military authority.
- 2.2 This relief is not applicable unless the affected party does the following:
 - 2.2.1 uses due diligence to remove the Force Majeure as quickly as possible, and
 - 2.2.2 provides the other party with prompt written notice of the cause and its anticipated effect.
- 2.3 The City may perform contract functions itself or contract them out during periods of Force Majeure. Such performance does not constitute a default or breach of this Agreement by the City.
- 2.4 If the Force Majeure continues for more than 30 days, the City Purchasing Agent or Director may terminate this Agreement by giving 30 days written notice to Contractor. This termination is not a default or breach of this Agreement. CONTRACTOR WAIVES ANY CLAIM IT MAY HAVE FOR FINANCIAL LOSSES OR OTHER DAMAGES RESULTING FROM THE TERMINATION EXCEPT FOR AMOUNTS DUE UNDER THE AGREEMENT AT THE TIME OF THE TERMINATION.

3.0 SEVERABILITY

- 3.1 If any part of this Agreement is for any reason found to be unenforceable, all other parts remain enforceable unless the result materially prejudices either party.

4.0 ENTIRE AGREEMENT

- 4.1 This Agreement merges the prior negotiations and understandings of the Parties and embodies the entire agreement of the Parties. No other agreements, assurances, conditions, covenants (express or implied), or other terms of any kind exist between the Parties regarding this Agreement.

5.0 WRITTEN AMENDMENT

- 5.1 Unless otherwise specified elsewhere in this Agreement, this Agreement may be amended only by written instrument executed on behalf of the City (by authority of an ordinance duly adopted by the City Council) and Contractor. The Director is only authorized to perform the functions specifically delegated to him or her in this Agreement.

6.0 APPLICABLE LAWS

6.1 This Agreement is subject to the laws of the State of Texas, the City Charter and Ordinances, the laws of the federal government of the United States, and all rules and regulations of any regulatory body or officer having jurisdiction.

6.2 Venue for any litigation relating to this Agreement is Harris County, Texas.

7.0 NOTICES

7.1 All notices to either party to the Agreement must be in writing and must be delivered by hand, facsimile, United States registered or certified mail, return receipt requested, United States Express Mail, Federal Express, Airborne Express, UPS or any other national overnight express delivery service. The notice must be addressed to the party to whom the notice is given at its address set out in Section I of this Agreement or other address the receiving party has designated previously by proper notice to the sending party. Postage or delivery charges must be paid by the party giving the notice.

8.0 NON-WAIVER

8.1 If either party fails to require the other to perform a term of this Agreement, that failure does not prevent the party from later enforcing that term and all other terms. If either party waives the other's breach of a term, that waiver does not waive a later breach of this Agreement.

8.2 An approval by the Director, or by any other employee or agent of the City, of any part of Contractor's performance does not waive compliance with this Agreement or establish a standard of performance other than that required by this Agreement and by law. The Director is not authorized to vary the terms of this Agreement.

9.0 INSPECTIONS AND AUDITS

9.1 City representatives may perform, or have performed, (1) audits of Contractor's books and records, and (2) inspections of all places where work is undertaken in connection with this Agreement. Contractor shall keep its books and records available for this purpose for at least 3 years after this Agreement terminates. This provision does not affect the applicable statute of limitations.

10.0 ENFORCEMENT

10.1 The City Attorney or his or her designee may enforce all legal rights and obligations under this Agreement without further authorization. Contractor shall provide to the City Attorney all documents and records that the City Attorney requests to assist in determining Contractor's compliance with this Agreement, with the exception of those documents made confidential by federal or State law or regulation.

11.0 AMBIGUITIES

11.1 If any term of this Agreement is ambiguous, it shall not be construed for or against any party on the basis that the party did or did not write it.

12.0 SURVIVAL

12.1 Contractor shall remain obligated to the City under all clauses of this Agreement that expressly or by their nature extend beyond the expiration or termination of this Agreement, including but not limited to, the indemnity provisions.

13.0 PARTIES IN INTEREST

13.1 This Agreement does not bestow any rights upon any third party, but binds and benefits the City and Contractor only.

14.0 SUCCESSORS AND ASSIGNS

14.1 This Agreement binds and benefits the Parties and their legal successors and permitted assigns; however, this provision does not alter the restrictions on assignment and disposal of assets set out in the following paragraph. This Agreement does not create any personal liability on the part of any officer or agent of the City.

15.0 BUSINESS STRUCTURE AND ASSIGNMENTS

15.1 Contractor shall not assign this Agreement at law or otherwise or dispose of all or substantially all of its assets without the City Purchasing Agent's or Director's prior written consent. Nothing in this clause, however, prevents the assignment of accounts receivable or the creation of a security interest under Section 9.406(c) of the Texas Business & Commerce Code. In the case of such an assignment, Contractor shall immediately furnish the City with proof of the assignment and the name, telephone number, and address of the Assignee and a clear identification of the fees to be paid to the Assignee.

15.2 Contractor shall not delegate any portion of its performance under this Agreement without the City Purchasing Agent's or Director's prior written consent.

16.0 REMEDIES CUMULATIVE

16.1 Unless otherwise specified elsewhere in this Agreement, the rights and remedies contained in this Agreement are not exclusive, but are cumulative of all rights and remedies which exist now or in the future. Neither party may terminate its duties under this Agreement except in accordance with its provisions.

17.0 CONTRACTOR DEBT

17.1 If Contractor, at any time during the term of this agreement, incurs a debt, as the word is defined in Section 15-122 of the Houston City Code of Ordinances, it shall immediately notify the City Controller in writing. If the City Controller becomes aware that Contractor has incurred a debt, she shall immediately notify contractor in writing. If Contractor does not pay the debt within 30 days of either such notification, the City Controller may deduct funds in an amount equal to the debt from any payments owed to Contractor under this agreement, and Contractor waives any recourse therefore.

EXHIBIT A DEFINITIONS

As used in this Agreement, the following terms have the meanings set out below:

"Additional Services" shall mean other services to repair systems associated with the submersible pump, not otherwise described in this specification, to bring the equipment to the working conditions agreeable to the Director and Contractor.

"Agreement" means this contract between the Parties, including all exhibits, change orders, and any written amendments authorized by City Council and Contractor.

"City" is defined in the preamble of this Agreement and includes its successors and assigns.

"City of Houston Normal Business Hours" shall mean 8:00 a.m. to 5:00 p.m., Monday to Friday, except on days which are considered City holidays.

"City Purchasing Agent" is defined as the person or duly authorized successor, authorized in writing to act for the City. The term includes, except as otherwise provided in this Contract, the authorized representative of the City Purchasing Agent acting within the limits of delegated authority.

"Contractor" is defined in the preamble of this Agreement and includes its successors and assigns.

"Countersignature Date" means the date this agreement is countersigned by the City Controller.

"Contractor Administrator" means the representative of the Public Works and Engineering Department who is responsible for the administration for the Contract.

"Contract Award Notice" means the official notification substantiated by the Notice to Proceed issued by the City Purchasing Agent to the Contractor.

"Contract Charges" means charges that accrue during a given month as defined in Article III.

"Contract Technical Representative" (CTR) shall mean the representative of the Director of the Appropriate Department assigned to verify services invoiced, maintain a record of available funds, comply with the terms of the contract, review the contract at the time of renewal, and administer the day-to-day activities of the Contract.

"Contract Term" is defined in Article IV.

"Contractor" is defined in the preamble of this Agreement and includes its successors and assigns.

"Contractor's Facility" shall mean place of business of the Contractor where the Contractor performs repairs of equipment and machinery for other entities, specifically where the Contractor plans to repair City of Houston submersible pumps of the model and size described in these specifications. The facility shall be equipped with the needed overhead/jib crane(s), lathe(s), drill(s), ovens, pressure washing machine, meggers, coil testers, balancing machine, paint booth, hydraulic press (es), and testing equipment to do the necessary repair/replacement work for the largest submersible pump in the group. The facility shall be clean, free from dirt and dust, to prevent contamination and damage during assembly of the submersible pumps and installation of bearings and gears.

"Contractor's Standard Business Hours" shall mean the daily eight (8) hour period Monday through Friday, which the contractor has established as their normal business day.

"Council Motion or Ordinance" shall mean the Official Document passed by the Governing Body designating

award(s) and directing the City Purchasing Agent to issue Notice(s) to Proceed.

"Countersignature Date" means the date this agreement is countersigned by the City Controller.

"Director" means the Director of the Public Works and Engineering Department, or the person he or she designates.

"Effective Date" is defined as the date the contract is countersigned by the City Controller.

"Established Contractor/Supplier" is defined as any bidder who engages in any practice or trade, or method of dealing regularly in a place, vocation or trade as to justify an expectation that the bidder can be expected to perform in a satisfactory manner with respect to this contract.

"Emergency Labor Rate" (ELR) shall mean the contractor's charge for labor for unscheduled, immediate, and continuous repair work that shall be carried out until the repair of the unit is completed. UDR must authorize all emergency works.

"Equipment Inventory (EI) Number" shall mean the unique, cradle-to-grave number called Equipment Inventory (EI) Number used by (MMS) to identify each piece of equipment.

"(EI) Tag" shall mean a metallic strip, embossed with the equipment inventory number (EI #), attached to each piece of equipment

"Governing Body" means the Mayor and City Council of the City of Houston.

"Hazardous Materials" is defined in Article II (Environmental Laws).

"Maintenance Management System" (MMS) shall mean a computerized database to manage work order process, and maintains historical data about performance and repair of equipment at the Water Production and Wastewater Operations branches of the Utilities Division, City of Houston.

"Non-repairable Shop Cost" shall mean the cost amount that the contractor can bill the City for the teardown, inspection, testing, and work scope/estimate preparation when the UDR determines that the submersible pump is not to be repaired (Non-Repairable).

"Non-Destructive Testing" (NDT) shall mean inspection to detect cracks and discontinuities by Magnetic Particle Methods, Penetrant Methods or any other Methods as needed and shall be performed by an NDT Level III Certified Technician. The Certification shall be in accordance to the latest Recommended Practices of the American Society for Non-Destructive Testing.

"Notice to Proceed" means a written communication from the City Purchasing Agent to Contractor instructing Contractor to begin performance.

"Other Repair Methods" shall mean any method of repair other than those prescribed in the Bid Form. These "other repair methods" must be authorized in writing by the equipment manufacturer and be approved by the Director.

"Overtime Labor Rate" (OLR) shall mean the contractor's charge for labor for work performed after contractor's Standard Business Hours. UDR must authorize all overtime works.

"Parties" mean all the entities set out in the Preamble who is bound by this Agreement.

"Recondition and repair" (recondition-repair) shall mean that the contractor, upon receipt of the unit, shall inspect and clean all components. Wash, dry, varnish, and bake stator. Clean excess varnish from stator fits. Check pump casing, impeller, volute, seals, and wear rings, if applicable. Check impeller fit on shaft.

Bring all motor/pump clearances to OEM standards. Dynamically balance rotating parts assembly, re-assemble, perform all tests, and check vibration at full rated voltage and frequency, and paint.

“Rewind and repair” (rewind-repair) shall mean that the contractor, upon receipt of the unit, shall inspect and clean all components. Burn stator, strip, and take data. Core test stator, rewind, connect, test, varnish dip /VPI stator, clean resin from stator fits. Check pump casing, impeller, volute, seals, and wear rings, if applicable. Check impeller fit on shaft. Bring all motor/pump clearances to OEM standards. Dynamically balance rotating parts assembly, re-assemble, perform all tests, and check vibration at full rated voltage and frequency, and paint.

“Standard Labor Rate “(SLR) shall mean the contractor’s charge for labor during contractor’s Standard Business Hours.

“Start of Contract Period” shall mean the date specified in the Notice to Proceed from the City Purchasing Agent.

“Non-OEM Parts” shall mean any After Market Part(s) that meets or exceeds Original Equipment Manufacturer’s standards.

“Submersible pump Groups” means the submersible pumps for the purpose of this contract are grouped such as to represent the manufacturer, operating voltage, speed, and the size of the units.

<u>Group Name</u>	<u>Manufacturer</u>	<u>Nominal Voltage (Volts)</u>	<u>Nominal Speed (RPM)</u>	<u>Horsepower (HP)</u>
Flygt:	Flygt	120,230,460	900 to 3600	Fractional HP to < or = 30 HP
Flygt	Flygt	230,460	900 to 3600	> 30 < or = 125 HP
KSB:	KSB	120,230,460	900 to 3600	Fractional HP to < or = 30 HP
Myers:	Myers	120,230,460	900 to 3600	Fractional HP to < or = 125 HP
Misc:	Miscellaneous	120,230,460	900 to 3600	Fractional HP to < or = 100 HP

“User Department Representative” (UDR) shall mean the representative of the Director of the Department assigned to administer the day-to-day activities of the Contract.

EXHIBIT B
SCOPE OF WORK/SPECIFICATIONS

(To be inserted by the City at the time of Contract execution)

EXHIBIT C
EQUAL EMPLOYMENT OPPORTUNITY

1. The contractor, subcontractor, vendor, supplier, or lessee will not discriminate against any employee or applicant for employment because of race, religion, color, sex, national origin, or age. The contractor, subcontractor, vendor, supplier, or lessee will take affirmative action to ensure that applicants are employed and that employees are treated during employment without regard to their race, religion, color, sex, national origin, or age. Such action will include, but not be limited to, the following: employment; upgrading; demotion or transfer; recruitment advertising; layoff or termination; rates of pay or other forms of compensation and selection for training, including apprenticeship. The contractor, subcontractor, vendor, supplier or lessee agrees to post in conspicuous places available to employees, and applicants for employment, notices to be provided by the City setting forth the provisions of this Equal Employment Opportunity Clause.

2. The contractor, subcontractor, vendor, supplier, or lessee states that all qualified applicants will receive consideration for employment without regard to race, religion, color, sex, national origin or age.

3. The contractor, subcontractor, vendor, supplier, or lessee will send to each labor union or representatives of workers with which it has a collective bargaining agreement or other contract or understanding, a notice to be provided by the agency contracting officer advising the said labor union or worker's representative of the contractor's and subcontractor's commitments under Section 202 of Executive Order No. 11246, and shall post copies of the notice in conspicuous places available to employees and applicants for employment.

4. The contractor, subcontractor, vendor, supplier, or lessee will comply with all provisions of Executive Order No. 11246 and the rules, regulations, and relevant orders of the Secretary of Labor or other Federal Agency responsible for enforcement of the equal employment opportunity and affirmative action provisions applicable and will likewise furnish all information and reports required by the Mayor and/or Contractor Compliance Officer(s) for purposes of investigation to ascertain and effect compliance with this program.

5. The contractor, subcontractor, vendor, supplier, or lessee will furnish all information and reports required by Executive Order No. 11246, and by the rules, regulations, and orders of the Secretary of Labor, or pursuant thereto, and will permit access to all books, records, and accounts by the appropriate City and Federal Officials for purposes of investigations to ascertain compliance with such rules, regulations, and orders. Compliance reports filed at such times as directed shall contain information as to the employment practice policies, program, and work force statistics of the contractor, subcontractor, vendor, supplier, or lessee.

6. In the event of the contractor's, subcontractor's, vendor's, supplier's, or lessee's non-compliance with the non-discrimination clause of this contract or with any of such rules, regulations, or orders, this contract may be canceled, terminated, or suspended in whole or in part, and the contractor, subcontractor, vendor, supplier, or lessee may be declared ineligible for further City contracts in accordance with procedures provided in Executive Order No. 11246, and such other sanctions may be imposed and remedies invoked as provided in the said Executive Order, or by rule, regulation, or order of the Secretary of Labor, or as may otherwise be provided by law.

7. The contractor shall include the provisions of paragraphs 1-8 of this Equal Employment Opportunity Clause in every subcontract or purchase order unless exempted by rules, regulations, or orders of the Secretary of Labor issued pursuant to Section 204 of Executive Order No. 11246 of September 24, 1965, so that such provisions will be binding upon each subcontractor or vendor. The contractor will take such action with respect to any subcontractor or purchase order as the contracting agency may direct as a means of enforcing such provisions including sanctions for noncompliance; provided, however, that in the event the contractor becomes involved in, or is threatened with litigation with a subcontractor or vendor as a result of such direction by the contracting agency, the contractor may request the United States to enter into such litigation to protect the interests of the United States.

8. The contractor shall file and shall cause his or her subcontractors, if any, to file compliance reports with the City in the form and to the extent as may be prescribed by the Mayor. Compliance reports filed at such times as directed shall contain information as to the practices, policies, programs, and employment policies and employment statistics of the contractor and each subcontractor.

EXHIBIT D
MWBE SUBCONTRACT TERMS

(To be inserted by the City at the time of Contract execution)

EXHIBIT E
DRUG POLICY COMPLIANCE AGREEMENT

(To be inserted by the City at the time of Contract execution)

**EXHIBIT F
CONTRACTOR'S CERTIFICATION OF NO SAFETY IMPACT POSITIONS
IN PERFORMANCE OF A CITY CONTRACT**

I, _____
(Name - Print/Type) **(Title)**

as an owner or officer of _____ (Contractor) have authority to bind the Contractor with respect to its bid, and I hereby certify that Contractor has no employee safety impact positions as defined in §5.18 of Executive Order No. 1-31 that will be involved in performing this City Contract. Contractor agrees and covenants that it shall immediately notify the City's Director of Personnel if any safety impact positions are established to provide services in performing this City Contract.

Date

Contractor Name

Signature

Title

**CONTRACTOR'S CERTIFICATION OF NON-APPLICATION OF
CITY OF HOUSTON DRUG DETECTION AND DETERRENCE PROCEDURES
FOR CONTRACTORS**

I, _____
(Name - Print/Type)

as an owner or officer of _____ (Contractor) have authority to bind the Contractor with respect to its bid, and I hereby certify that Contractor has fewer than fifteen (15) employees during any 20-week period during a calendar year and also certify that Contractor has no employee safety impact positions as defined in §5.18 of Executive Order No. 1-31 that will be involved in performing this City Contract. Safety impact position means a Contractor's employment position involving job duties that if performed with inattentiveness, errors in judgment, or diminished coordination, dexterity, or composure may result in mistakes that could present a real and/or imminent threat to the personal health or safety of the employee, co-workers, and/or the public.

Date

Contractor Name

Signature

Title

**EXHIBIT G
DRUG POLICY COMPLIANCE DECLARATION**

(To be inserted by the City at the time of Contract execution)

**EXHIBIT H
FEES AND COSTSS**

(To be inserted by the City at the time of Contract execution)

**EXHIBIT I
PAY OR PLAY**

(To be inserted by the City at the time of Contract execution)